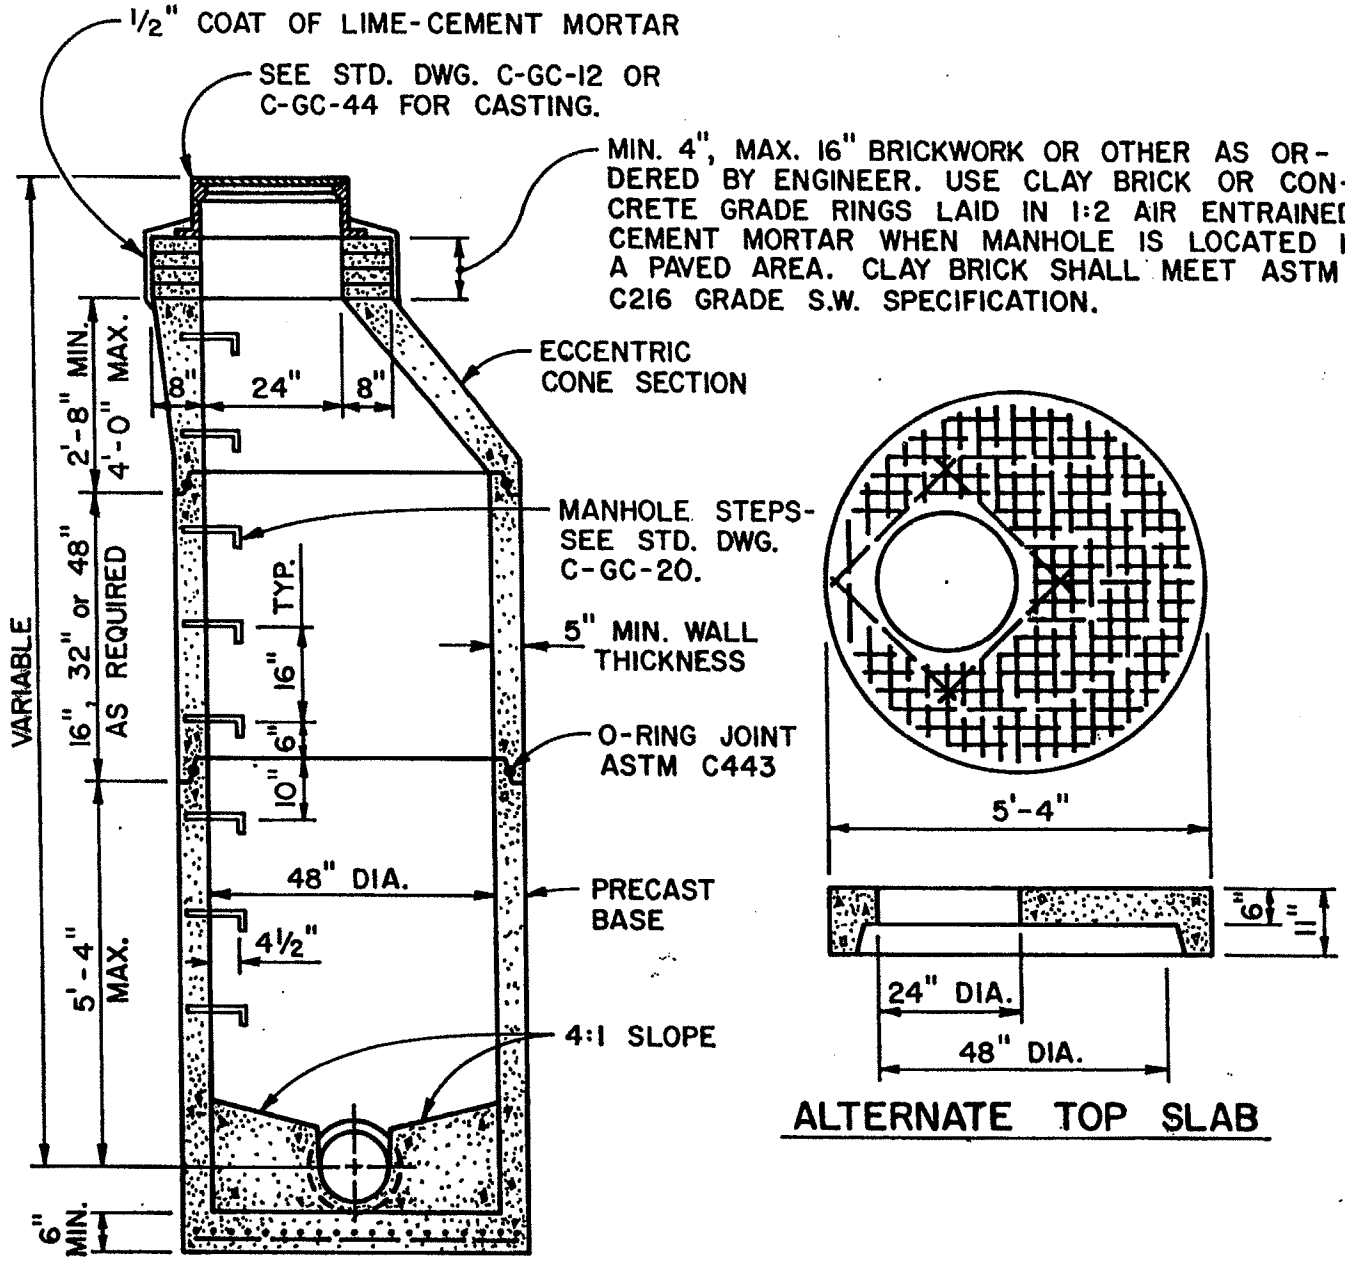

1. SEWER PIPE WILL BE SECURED THROUGH THE MANHOLE WALL BY "KOR-N-SEAL" BOOT, "PRESS WEDGE II" GASKET, OR AN APPROVED EQUIVALENT.
2. ALL CONSTRUCTION AND MATERIALS SHALL CONFORM TO ASTM SPECIFICATION C478-70, UNLESS OTHERWISE SHOWN.
3. ALL CONCRETE SHALL BE CLASS C.
4. FIELD CUT OPENINGS SHALL BE DONE ONLY AS DIRECTED BY THE ENGINEER.

APPROVED
EVANS, MECHWART, HAMBLETON & TILTON, INC.
By
CITY ADMINISTRATOR

PRECAST CONCRETE PIPE MANHOLE

CITY OF GROVE CITY, OHIO

STANDARD CONSTRUCTION DRAWING

REV.	DATE	DWG. Nº
11-17-93		C-GC-3