



SEE SHEET 2/2 FOR ADDITIONAL NOTES

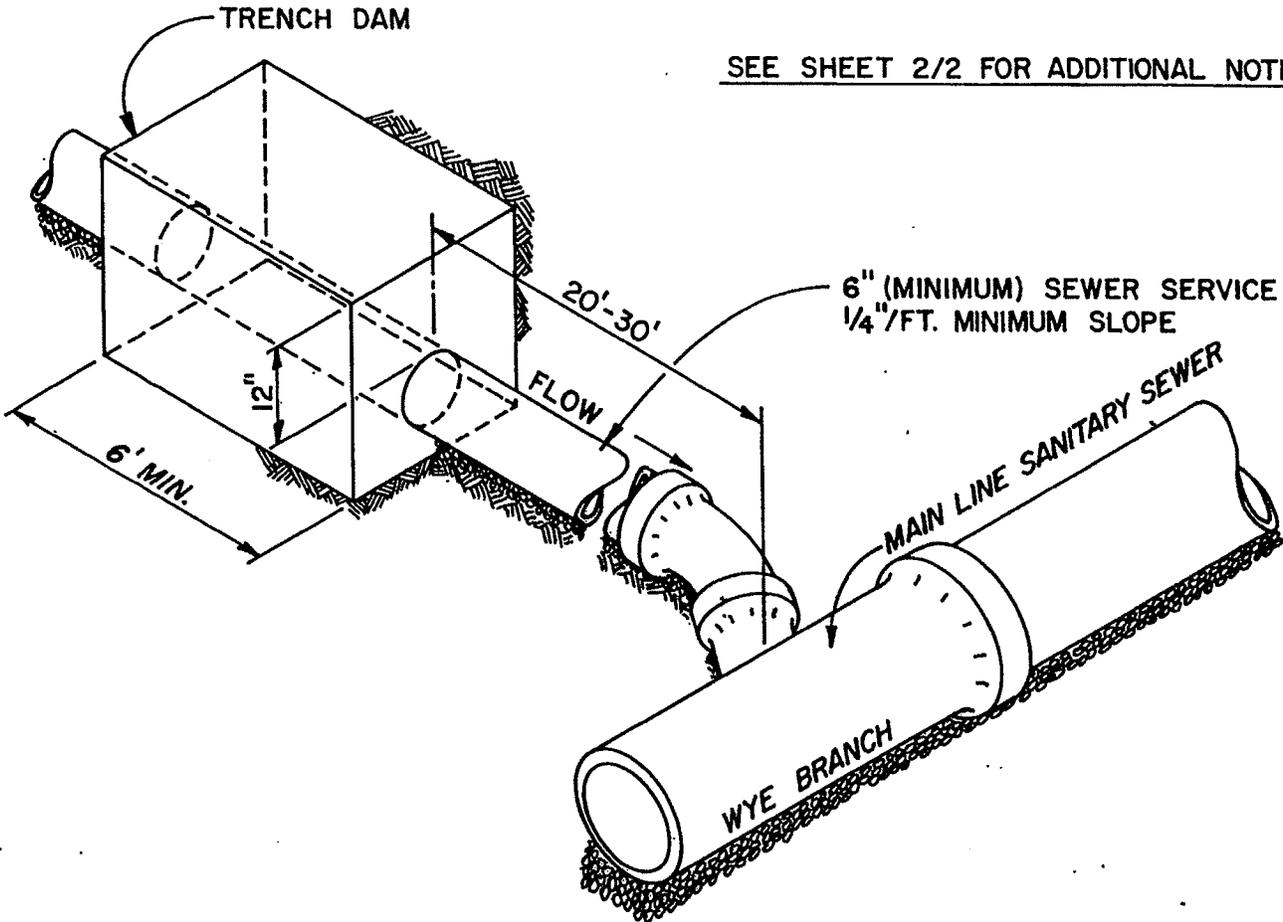


PERSPECTIVE VIEW

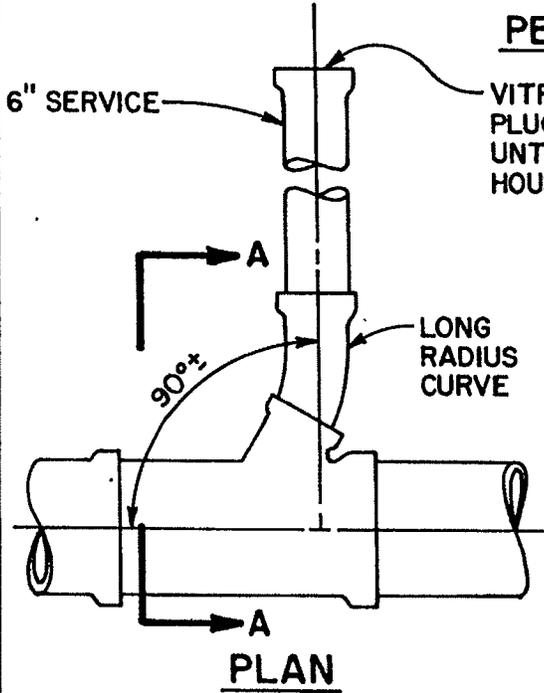

PLAN

VITRIFIED OR P.V.C. STOPPER
PLUG SEALED IN PLACE
UNTIL CONNECTED TO
HOUSE PLUMBING.

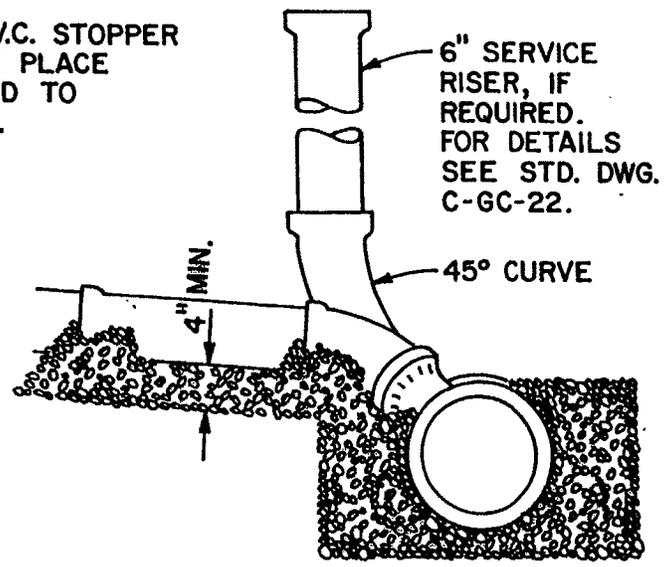

SECTION A-A

1/2

APPROVED
EVANS, MECHWART, HAMBLETON & TILTON, INC.

By *Robert E. Kishman*
Philip D. ...
 CITY ADMINISTRATOR

**6-INCH SANITARY
SEWER SERVICE**

CITY OF
GROVE CITY, OHIO

**STANDARD
CONSTRUCTION DRAWING**

REV.
11-17-93

DATE

DWG. NO
C-GC-37

NOTES

WHEN A WYE BRANCH IS NOT AVAILABLE IN THE MAIN LINE SEWER, THE MAIN LINE MAY BE TAPPED AS SHOWN IN STANDARD DRAWING C-GC-30 OR AS APPROVED BY THE THE CITY ENGINEER.

NO TAP SHALL BE MADE INTO ANY SANITARY SEWER UNTIL ALL PERMITS HAVE BEEN OBTAINED, ALL LEGAL FEES PAID, AND THE SERVICE DEPARTMENT NOTIFIED THREE DAYS PRIOR TO BEGINNING WORK.


THE CONTRACTOR SHALL PLACE A BEDDING CUT OFF TRENCH DAM OF NATIVE CLAY OR IMPERVIOUS SOIL ACROSS AND ALONG THE TRENCH AT A POINT 20 TO 30 FEET UPSTREAM FROM THE MAIN LINE SEWER WYE, TEE OR SADDLE TO RETARD AND RESIST THE MOVEMENT OF GROUNDWATER THROUGH THE TRENCH GRANULAR BEDDING OR BACKFILL MATERIAL. THE TRENCH DAMS SHALL BE CAREFULLY COMPACTED AND SHALL BE 6 FEET IN THICKNESS, AS MEASURED ALONG THE SERVICE CENTERLINE AND SHALL BE CONSTRUCTED AGAINST THE UNDISTURBED TRENCH SIDES FROM THE BOTTOM OF THE TRENCH TO A LIMIT OF 12 INCHES OVER THE TOP OF THE PIPE.

FOR BEDDING MATERIAL SEE STANDARD DRAWINGS C-GC-26 AND C-GC-27. PRIVATE SERVICES DO NOT REQUIRE GRANULAR BEDDING.

2
2

APPROVED
EVANS, MECHWART, HAMBLETON & WILTON, INC.

By

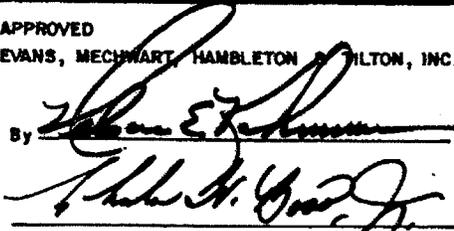
CITY ADMINISTRATOR

6 - INCH SANITARY
SEWER SERVICE

CITY OF
GROVE CITY, OHIO

STANDARD
CONSTRUCTION DRAWING

REV.
11-17-93

DATE

DWG. Nº
C-GC-37