


SIDEWALK PLAN

w = 4' for Residential & Collector
 w = 5' for Arterial

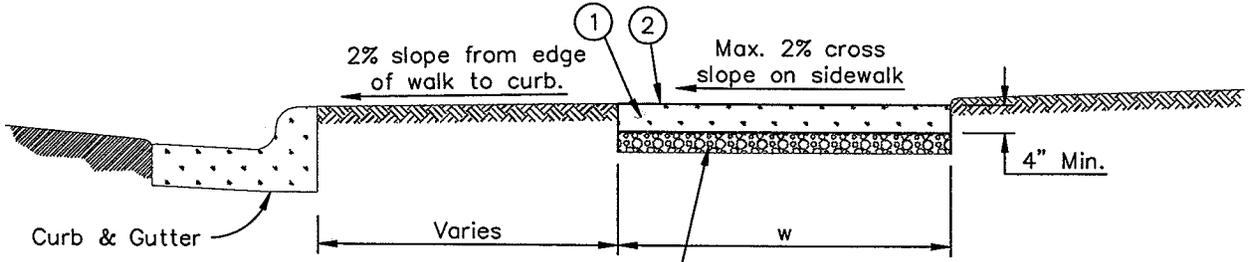

Subgrades excavated below the prescribed grade shall be filled with an approved crushed aggregate and compacted as directed.

SECTION "A-A"

NOTES:

1. Sidewalks shall be constructed according to Item 608, CMSC, current edition.
2. All joints and edges to be tooled after broom finish.
3. All castings within sidewalk shall be set flush with concrete and bolted down.
4. All concrete shall be CMSC Class "C" with 6%, ±1%, air entrainment.

	STANDARD DIMENSIONS FOR TYPICAL SIDEWALK DETAIL	CITY OF GROVE CITY, OHIO	
		STANDARD CONSTRUCTION DRAWING	
		Effective Date: 5-30-02	Dwg. No. C-GC-46