



PLAN VIEW

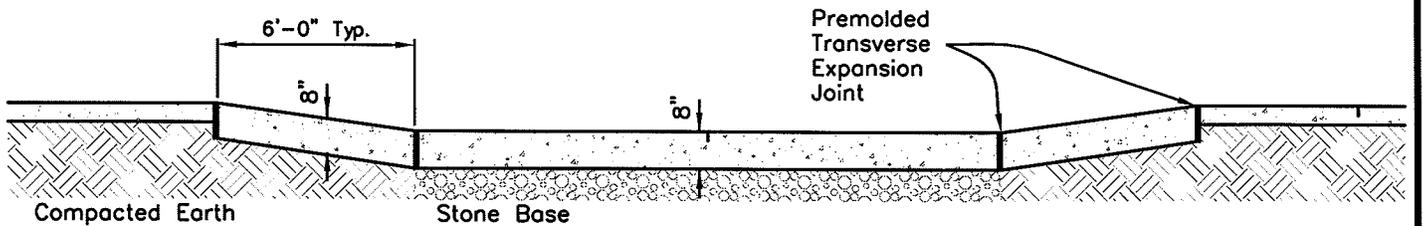

SECTION B-B

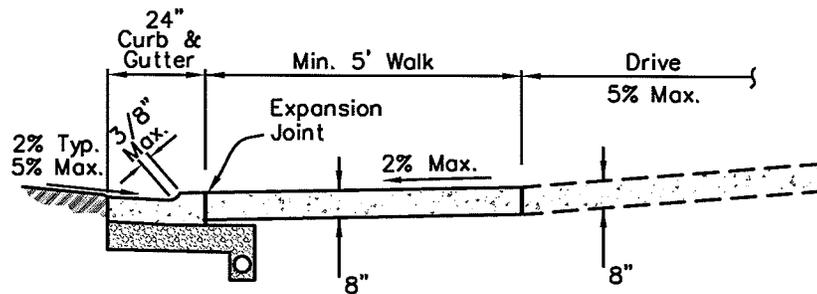

SECTION A-A

NOTES

1. Concrete for driveway shall be ODOT Class "S", Air Entrained Concrete w/ Limestone Aggregate and 715lbs. of cement per C.Y., maximum 4" slump, broom finish with edge trowel. No Fly Ash or GGBFS in concrete. Contraction joints as shown, sawn not less than 3" deep.
2. Contractor is responsible for protecting adjacent driveway, sidewalk, underdrain, and street lighting cable and replacement of same if damaged due to Contractor's work.
3. Sidewalks shall be constructed according to C-GC-46A.
4. All joints and edges are to be tooled.
5. All castings shall be set to be flush and at proper grade, 1/4" max. lip.

COMMERCIAL DRIVE
W/ SIDEWALK
ADJACENT TO CURB
ON PUBLIC R/W

CITY OF GROVE CITY, OHIO

STANDARD
CONSTRUCTION DRAWING

Effective Date
10-31-05

Revision Date
11-15-05

Dwg. No.
C-GC-46C