


* Keep flush at curb ramps.

T = 6" - Residential/Local Streets

T = 8" - Collector & Secondart Arterial Streets

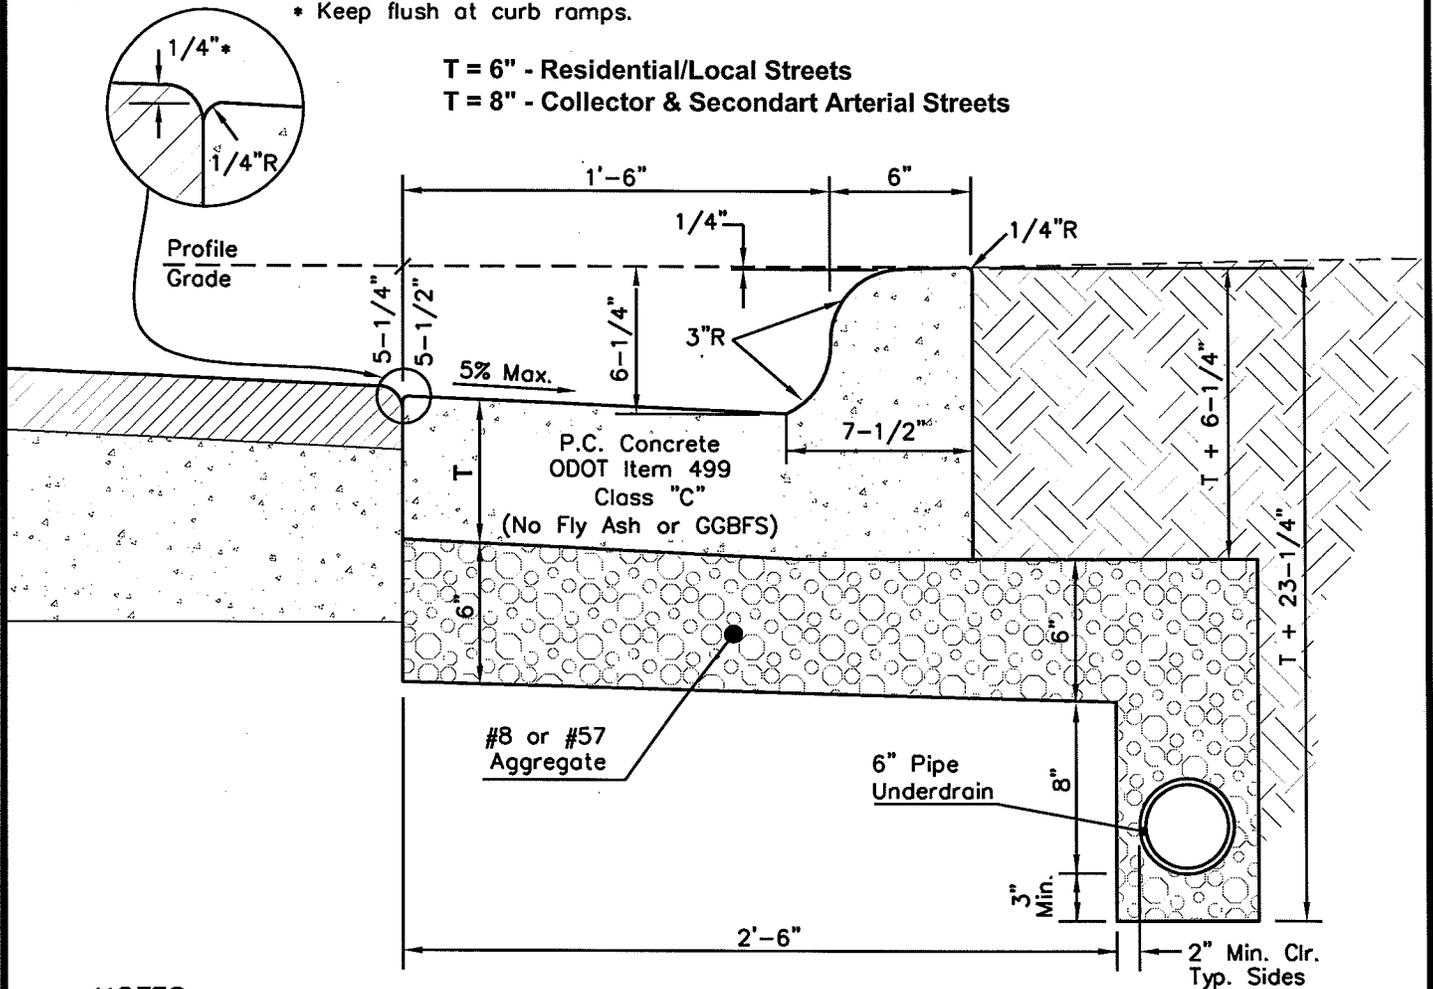

NOTES

1. Curb & gutter shall consist of 1.26 C.F. (6") of concrete per linear foot for residential or local streets and 1.59 C.F. (8") of concrete for collector or arterial streets.
2. All exposed surfaces of concrete curb & gutter shall have a brush finish and completely covered with concrete cure and seal, including the backside of curb.
3. 3/4" expansion joints shall be installed at right angles to the curb line within 10' of all immovable structures and at points of curvature.
4. Contraction joints shall be saw cut at 10' intervals, not less than 2" deep, and as soon as possible without causing damage to the concrete.
5. Tolerances shall not exceed 1/4" for section, grade, surface variation, or alignment.
6. 4" underdrain installed directly under the curb is permitted for use in industrial/commercial areas where roof drains & sump pumps are not drained to street.
7. The letter "W" shall be imprinted into the curb directly opposite all water service boxes and the letter "M" shall be imprinted opposite all water line valves, including hydrant watch valves. Letters shall be 3" high/wide with 1/4" thick bars, imprinted 1/2" into the face of the curb, 2-1/2" above the gutter.

ITEM 609: STANDARD
CONCRETE COMBINED
CURB & GUTTER
(CONTINUOUS)

CITY OF GROVE CITY, OHIO

STANDARD
CONSTRUCTION DRAWING

Effective Date
4-15-05

Revision Date
11-15-05

Dwg. No.
C-GC-57A