



RISER

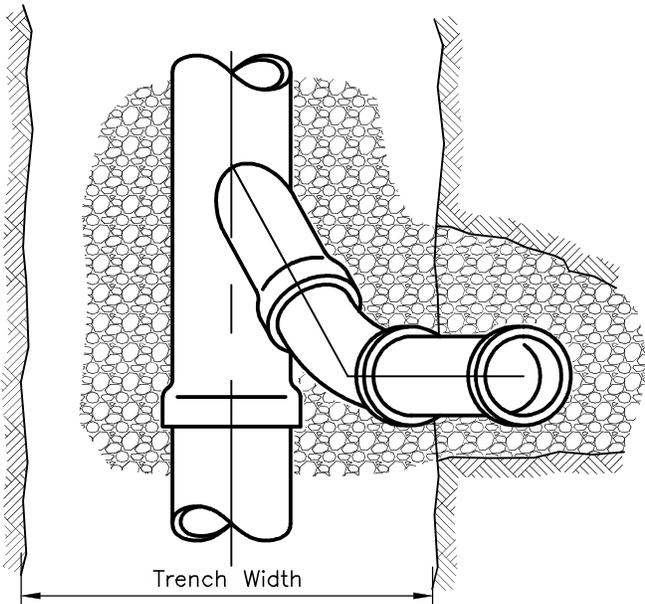


PLAN VIEW

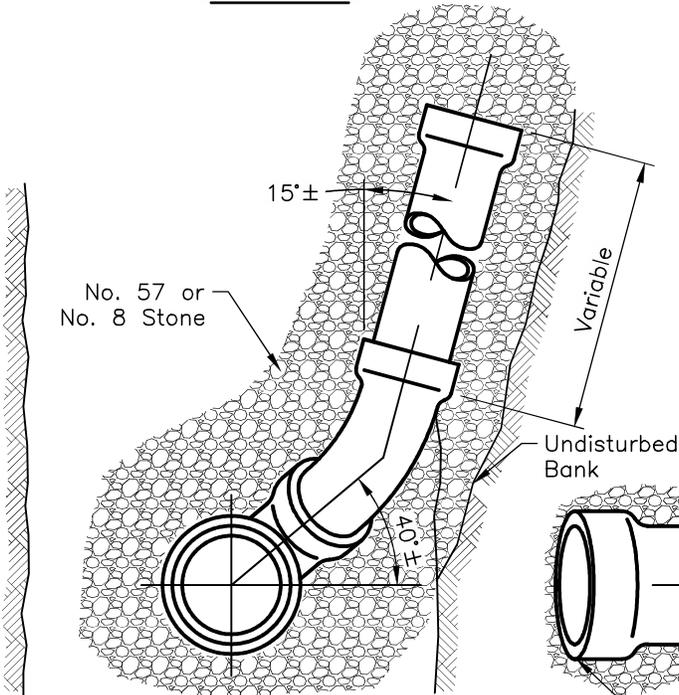


END VIEW

CLEANOUT

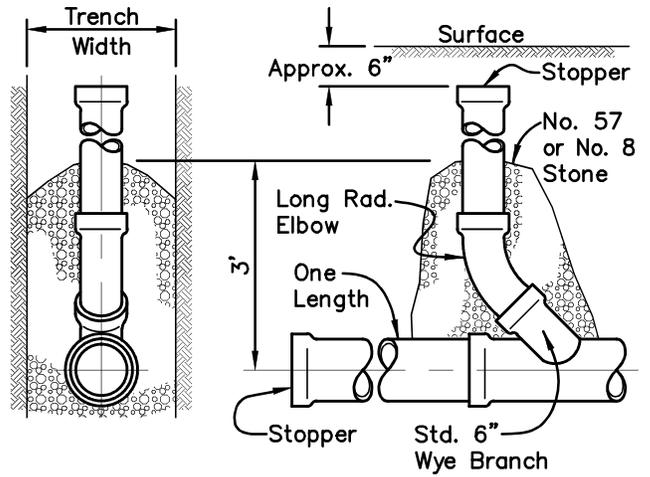

END VIEW

SIDE VIEW

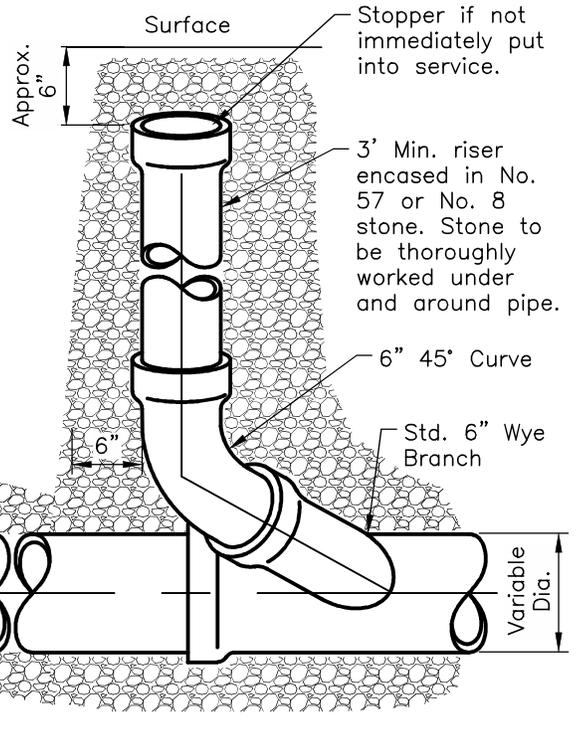


SIDE VIEW

DETAIL NOTES

Risers shall be installed, when the depth exceeds 10 feet, from the lateral sewer fitting to a point 9 feet ±1 foot below existing or proposed surface elevation, whichever is higher, unless otherwise indicated on approved sewer plan. Riser extensions shall be a minimum of 3 feet in length.

Approved By:

 City Engineer, EMH&T Inc

 City Service Director

STANDARD DIMENSIONS
 FOR
**TYPICAL RISER AND
 CLEANOUT**

**CITY OF
 GROVE CITY, OHIO**
 STANDARD
 CONSTRUCTION DRAWING
 Revised October 2015 Drawing No. C-GC-22