


CUT-IN WYE SERVICE CONNECTION

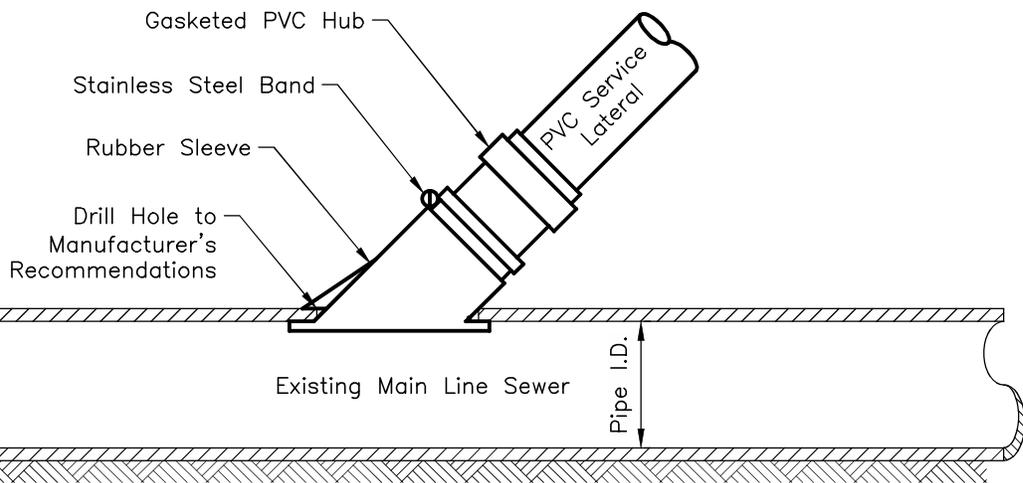


THREE PIECE SERVICE CONNECTION

(Inserta Wye™ or Approved Equal)

DETAIL NOTES

1. New 6-in sanitary laterals on existing sewer pipes shall be installed according to one of the options shown above.
2. Core hole for the 3-piece service connection option shall be made according to the manufacturer's requirements. No pipe chipping or breaking is permitted.
3. The connections shall be water-tight and made using rubber sleeves and stainless steel bands.
4. For the cut-in wye option, a minimum 4-in granular bedding consisting of No. 8 or No. 57 aggregate shall be installed around the new service wye.
5. The flowline and grade of the existing main line sewer shall be maintained and unobstructed at all times.
6. If the house connection is not made immediately after installation of the wye a stopper must be installed.

<p>Approved By:</p>  <p>City Engineer, EMH&T Inc</p>  <p>City Service Director</p>	<p>STANDARD DIMENSIONS FOR</p> <p>SERVICE CONNECTION FOR EXISTING SANITARY SEWER PIPE</p>	<p>CITY OF GROVE CITY, OHIO</p>	
		<p>STANDARD CONSTRUCTION DRAWING</p> <p>Revised October 2015</p>	<p>Drawing No. C-GC-30</p>