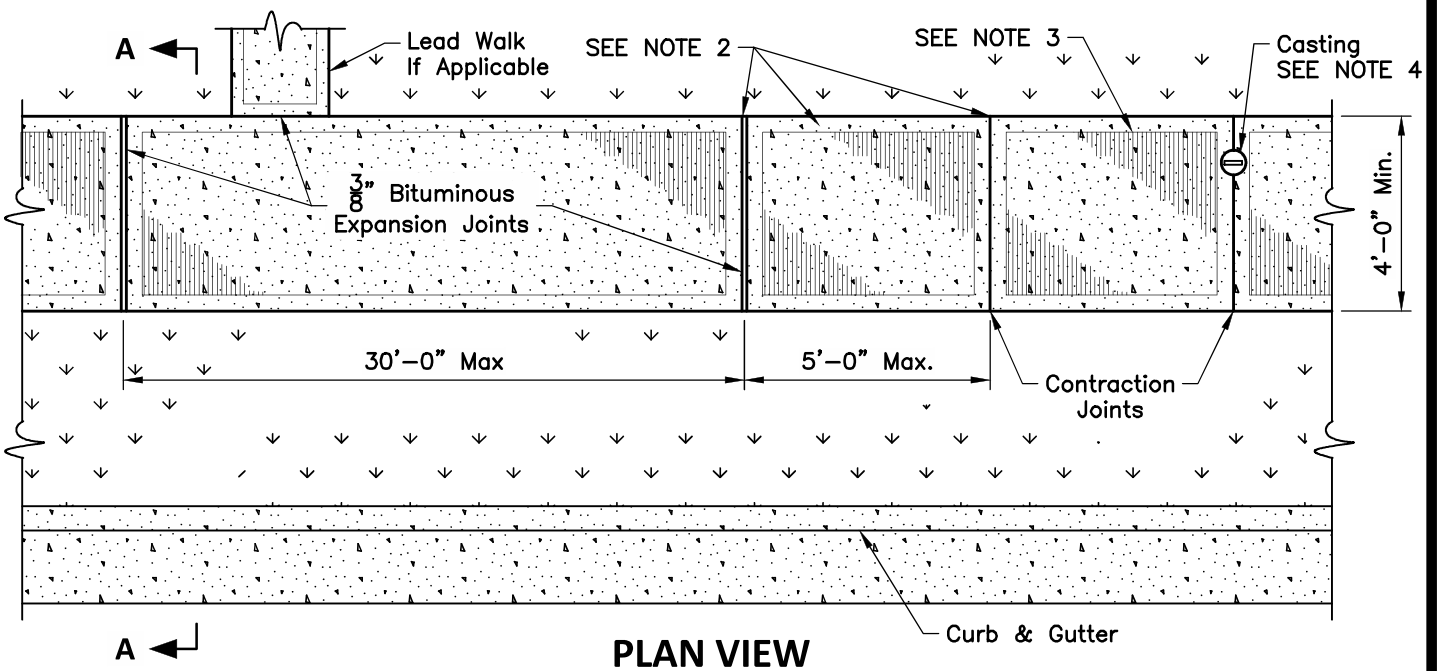

PLAN VIEW

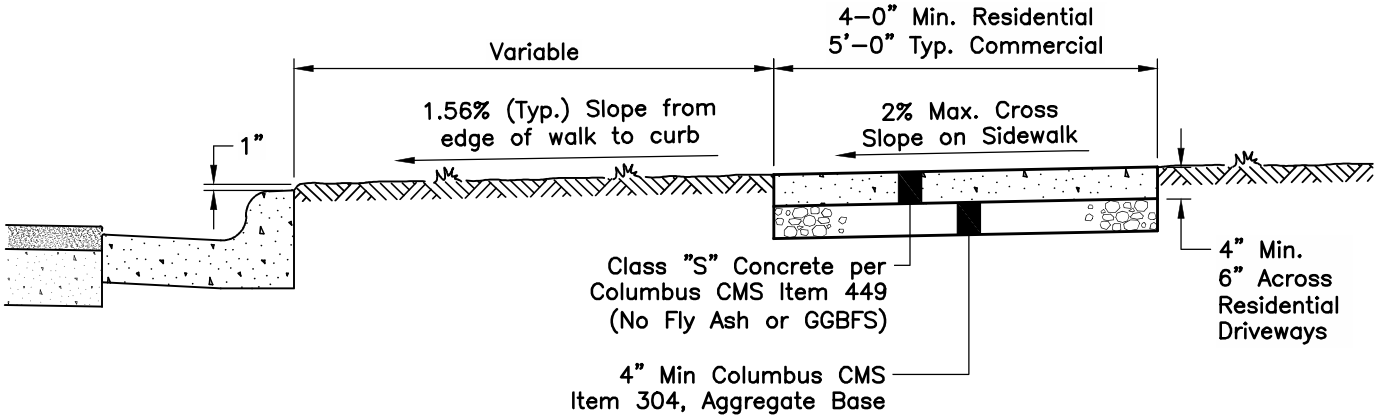

SECTION A-A

DETAIL NOTES

1. Sidewalks shall be constructed according to Columbus CMS Item 608, Current Edition.
2. All joints and edges shall be tooled after broom finish.
3. Sidewalk surface shall have a broom finish.
4. All castings shall be set to proper grade. Where feasible, tool a joint at the casting location to control cracking.
5. All concrete shall contain 6% + 1% air entrainment.
6. Contraction Joints shall be not less than 2-in in depth.
7. Contractor shall apply a cure & seal compound, as approved by the City, to finished concrete.

Approved By: City Engineer, EMH&T Inc City Service Director	STANDARD DIMENSIONS FOR **TYPICAL SIDEWALK DETAIL**	**CITY OF GROVE CITY, OHIO** STANDARD CONSTRUCTION DRAWING Revised: October 2015 Drawing No.: C-GC-46A