


PLAN VIEW

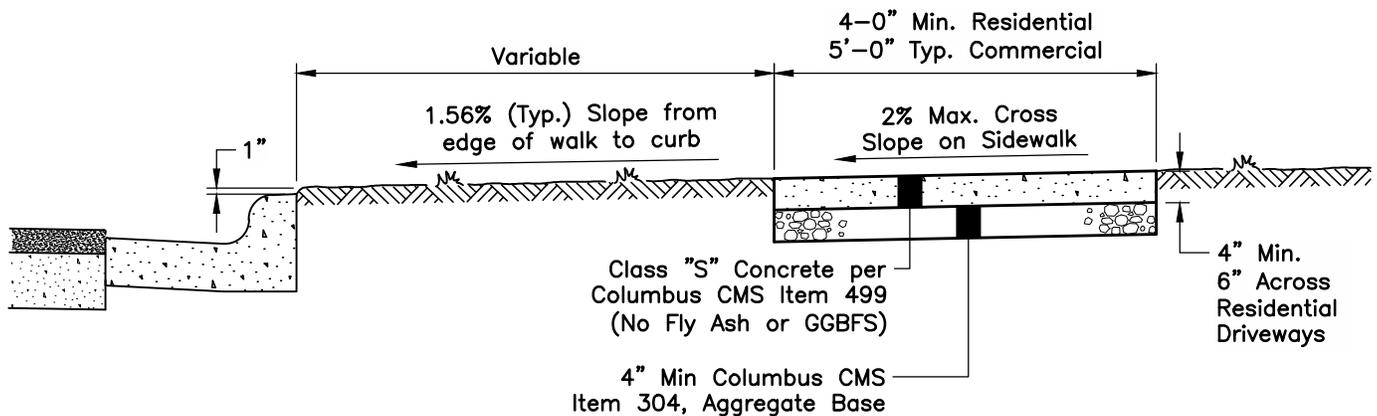


SECTION A-A

DETAIL NOTES

1. Sidewalks shall be constructed according to Columbus CMS Item 608.
2. All joints and edges shall be tooled after broom finish.
3. Sidewalk surface shall have a broom finish.
4. All castings shall be set to proper grade. Where feasible, tool a joint at the casting location to control cracking.
5. All concrete shall contain 6% ±2% air entrainment.
6. Contraction Joints shall be not less than 2-in in depth.
7. Contractor shall apply a cure & seal compound, as approved by the City, to finished concrete.

Approved By:

 City Engineer, EMH&T Inc

 City Service Director

STANDARD DIMENSIONS
 FOR
TYPICAL SIDEWALK DETAIL

CITY OF GROVE CITY, OHIO

STANDARD
 CONSTRUCTION DRAWING

Revised		Drawing No.
March 2016		C-GC-46A