


**CATCH BASIN NOTES**


- A. LOCATION AND ELEVATIONS WHEN GIVEN ON THE PLANS IS TOP CENTER OF THE GRATE. WHEN SIDE OPENINGS ARE PROVIDED, ELEVATION SHALL BE THE FLOW LINE OF THE SIDE INLET.
- B. GRATE FOR NON-PAVED AREAS SHALL BE EAST JORDAN IRON WORKS 5110 TYPE M3 OR NEENAH CATALOG NO. R-4859-C OR EQUIVALENT.
- C. GRATE ELEVATION TO BE PLACED 4" TO 6" BELOW NORMAL DITCH RETURNING TO NORMAL 10' EACH SIDE OF BASIN.
- D. CONCRETE, CAST-IN-PLACE, TO BE ODOT QC MISC. (CEMENT ONLY - NO POZZOLAN MATERIAL). ALL PRECAST CONCRETE SHALL MEET THE REQUIREMENTS OF 706.13 WITH 6% ± 2% AIR VOID CONTENT IN THE HARDENED CONCRETE AND BE MARKED WITH CATCH BASIN NUMBER. OPENINGS FOR PIPES SHALL BE O.D. +2" WHEN FABRICATED OR FIELD CUT.
- E. CATCH BASINS NOT PERMITTED IN PAVED AREAS UNLESS USING A FRAME AND GRATE EQUIVALENT OF NEENAH CATALOG NO. R-3405 OR EAST JORDAN IRON WORKS NO. V-5250.
- F. FOR PIPES OVER 18" REFER TO ODOT CATCH BASIN 2-3 AND 2-4. FOR SIDE INLETS REFER TO ODOT CATCH BASIN 2-2-A.
- G. CARE SHALL BE TAKEN WHEN CONNECTING TO AN EXISTING CATCH BASIN TO KEEP OPENING AS MINIMAL AS POSSIBLE. IF POSSIBLE, SAW CUT OR USE ROTARY HAMMER FOR OPENING TO MINIMIZE DAMAGE TO CATCH BASIN. PIPE TO INTRUDE INTO CATCH BASIN 1" ONLY AND PIPE MUST BE CUT PARALLEL TO CATCH BASIN. USE NONSHRINK GROUT AROUND PIPE TO SEAL BETWEEN PIPE AND CATCH BASIN.

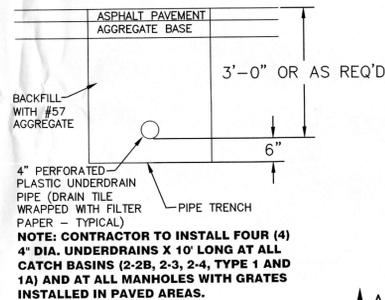

**NOTE: CONTRACTOR TO INSTALL FOUR (4) 4" DIA. UNDERDRAINS X 10' LONG AT ALL CATCH BASINS (2-2B, 2-3, 2-4, TYPE 1 AND 1A) AND AT ALL MANHOLES WITH GRATES INSTALLED IN PAVED AREAS.**

**COMBINED CURB AND SIDEWALK DETAIL NOTES**


- A. WALK TO BE POURED ON 4" MIN. COMPACTED STRUCTURAL BEDDING.
- B. PROVIDE BROOM FINISH TO ALL EXPOSED SURFACES.
- C. CONCRETE SHALL CONFORM TO ODOT ITEM 499 CONCRETE. CONCRETE WORK SHALL CONFORM TO ODOT ITEM 608, UNLESS OTHERWISE SPECIFIED WITHIN.
- D. PROVIDE EDGING AROUND ALL EXPOSED SURFACES.
- E. USE WHITE PIGMENTED CURING COMPOUND IMMEDIATELY AFTER FINISHING SURFACES. ANY OTHER METHOD OR TYPE OF CURING COMPOUND MUST BE PREAPPROVED.
- F. ALL CONCRETE SHALL BE ODOT QC MISC. (CEMENT ONLY - NO POZZOLAN MATERIAL).
- G. PROPOSED CONCRETE SIDEWALK SHALL BE JOINTED AS CLOSE TO SQUARE AS POSSIBLE. JOINT SPACING MAY VARY SLIGHTLY DEPENDING ON THE LENGTH AND WIDTH OF THE PROPOSED SIDEWALK AREAS. JOINT SPACING SHALL TYPICALLY RANGE FROM 4'X4' TO 10'X10'. IN ALL CASES THE SIDEWALK SHALL BE JOINTED SO THAT THE MAXIMUM ASPECT RATIO (OF PANEL LENGTH TO WIDTH) OF THE JOINTING IS 1.25:1 OR LESS. CONTRACTOR TO VERIFY METHOD AND TYPE OF CONTROL JOINTING WITH OWNER PRIOR TO PERFORMING WORK.
- H. CURB/SIDEWALK SHALL HAVE EXPANSION JOINTS EVERY 100'.

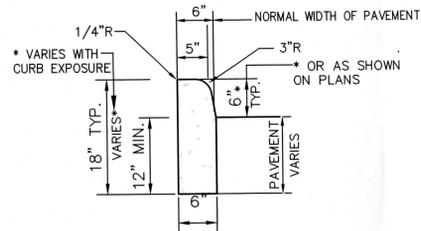

**TYPE 6 BARRIER CURB**

**CURB NOTES**


- A. CONCRETE AND WORK SHALL MEET THE REQUIREMENTS SET FORTH IN ODOT ITEM 609 CURBING.
- B. CURBING SHALL HAVE CONTRACTION JOINTS EVERY 10' AND EXPANSION JOINTS EVERY 100'.
- C. MINIMUM OF 6" OF ODOT 304 SHALL BE PLACED UNDER CURBING.
- D. CURBING SHALL BE BACKFILLED IMMEDIATELY AFTER FORMS ARE REMOVED OR AS SOON AS PRACTICAL WHEN SLIPFORMING PRIOR TO OTHER CONSTRUCTION OPERATIONS.
- E. PROVIDE BROOM FINISH AND EDGING TO ALL EXPOSED SURFACES.
- F. APPLY WHITE PIGMENTED CURING COMPOUND ON ALL SURFACES INCLUDING BACK IMMEDIATELY AFTER FINISHING SURFACES. ANY OTHER METHOD OR TYPE OF CURING COMPOUND MUST BE PREAPPROVED.
- G. ALL CONCRETE SHALL BE ODOT QC MISC. (CEMENT ONLY - NO POZZOLAN MATERIAL).




**NOTES**

- A. WALK TO BE POURED ON 4" MIN. COMPACTED STRUCTURAL BEDDING.
- B. PROVIDE BROOM FINISH TO ALL EXPOSED SURFACES.
- C. CONCRETE SHALL CONFORM TO ODOT ITEM 499 CONCRETE. CONCRETE WORK SHALL CONFORM TO ODOT ITEM 608, UNLESS OTHERWISE SPECIFIED WITHIN.
- D. PROVIDE EDGING AROUND ALL EXPOSED SURFACES.
- E. USE WHITE PIGMENTED CURING COMPOUND IMMEDIATELY AFTER FINISHING SURFACES. ANY OTHER METHOD OR TYPE OF CURING COMPOUND MUST BE PREAPPROVED.
- F. ALL CONCRETE SHALL BE ODOT QC MISC. (CEMENT ONLY - NO POZZOLAN MATERIAL).
- G. PROPOSED CONCRETE SIDEWALK SHALL BE JOINTED AS CLOSE TO SQUARE AS POSSIBLE. JOINT SPACING MAY VARY SLIGHTLY DEPENDING ON THE LENGTH AND WIDTH OF THE PROPOSED SIDEWALK AREAS. JOINT SPACING SHALL TYPICALLY RANGE FROM 4'X4' TO 10'X10'. IN ALL CASES THE SIDEWALK SHALL BE JOINTED SO THAT THE MAXIMUM ASPECT RATIO (OF PANEL LENGTH TO WIDTH) OF THE JOINTING IS 1.25:1 OR LESS. CONTRACTOR TO VERIFY METHOD AND TYPE OF CONTROL JOINTING WITH OWNER PRIOR TO PERFORMING WORK.
- H. SIDEWALK SHALL HAVE EXPANSION JOINTS EVERY 100'.

**SIDEWALK DETAIL**

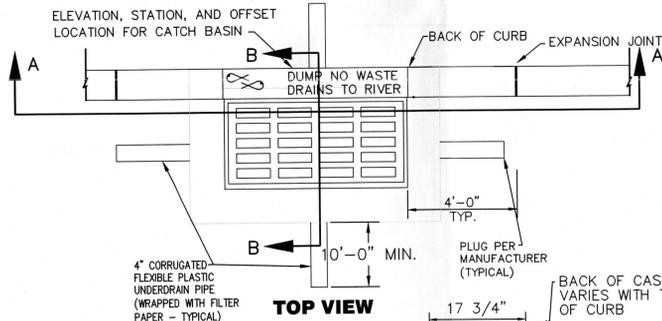


**TOP VIEW**

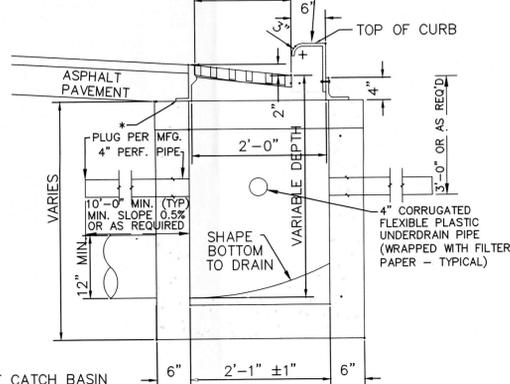

**SECTION B-B**

\* NOTE: SHIMMING OF CATCH BASIN FRAME MAY BE REQUIRED TO KEEP LIP OF GUTTER CONSISTENT.

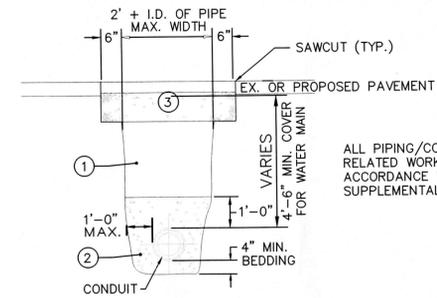


**TRENCH DETAIL**

NO SCALE

**NOTES**

- NO MATERIAL SHALL BE USED FOR BACKFILLING THAT CONTAINS STONES, ROCKS, ETC., GREATER THAN 3" IN DIAMETER.
- ALL TRENCHES WITHIN 5' OF FUTURE OR EXISTING BUILDINGS, PAVEMENT EDGES, CURB, DRIVEWAYS OR WALKS SHALL BE BACKFILLED WITH STRUCTURAL MATERIAL.
- THE OPEN ENDS OF ALL PIPES AND SPECIAL CASTINGS SHALL BE PLUGGED OR OTHERWISE CLOSED WITH A WATERTIGHT PLUG TO THE APPROVAL OF THE GOVERNING AGENCY BEFORE LEAVING THE WORK FOR THE NIGHT.
- ① OFF-PAVEMENT BACKFILL CAN BE COMPACTED EXISTING NATIVE MATERIAL IN 12" MAXIMUM LIFTS OR AS APPROVED BY THE GOVERNING AGENCY. IN-PAVEMENT STRUCTURAL BACKFILL MATERIAL SHALL BE ODOT SPECIFICATION 304 CRUSHED STONE IN 6" MAXIMUM LIFTS UNLESS OTHERWISE APPROVED DEPENDING ON COMPACTING METHOD AND EQUIPMENT. IN EXISTING ROADWAYS BACKFILL SHALL CONSIST OF LOW DENSITY MORTAR BACKFILL.
- ② STRUCTURAL BEDDING SHALL BE CRUSHED STONE OR GRAVEL, ODOT SPECIFICATION #57 OR #67, OR OTHER APPROVED EQUAL.
- ③ OFF PAVEMENT AREAS SHALL BE PROVIDED WITH A MINIMUM OF 6" OF TOPSOIL OVER THE COMPACTED NATIVE MATERIAL AND THEN SEEDED AND MULCHED PER ITEM 659.

ALL PIPING/CONDUITS AND RELATED WORK IS TO BE IN ACCORDANCE WITH ODOT SUPPLEMENTAL SPEC. 811.

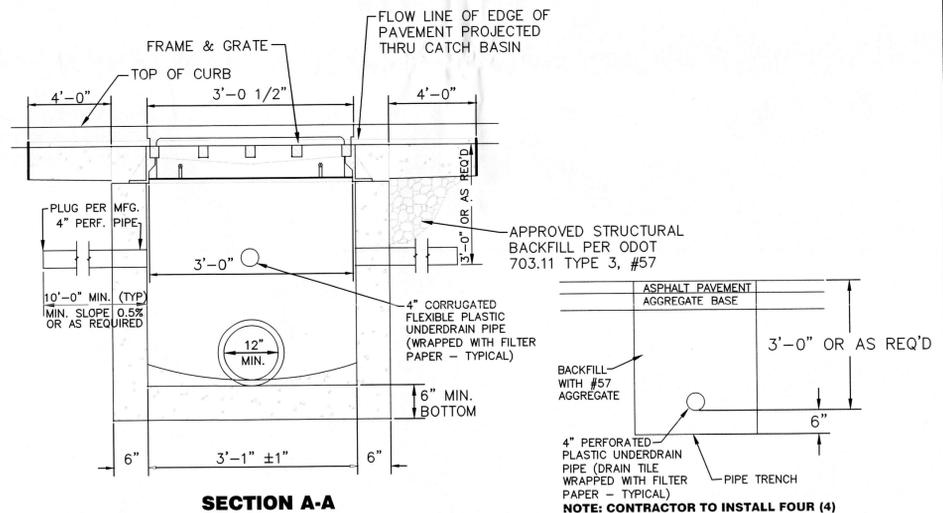

**SECTION A-A**

**TYPE 1 CATCH BASIN**

NOTE: ALL STRUCTURES AND RELATED WORK IS TO BE IN ACCORDANCE WITH ODOT SUPPLEMENTAL SPEC. 811.

**TYPE 1 CATCH BASINS NOTES**

- A. CASTING SHALL BE EAST JORDAN IRON WORKS 7030 OR NEENAH R-3246 OR EQUIVALENT.
- B. CATCH BASIN IN DRIVE APPROACHES (TO BE AVOIDED, IF POSSIBLE) THE BACKS SHALL BE EAST JORDAN IRON WORKS TYPE T3 OR NEENAH (R-3246-A) WITH CURB PLATE.
- C. STANDARD GRATE SHALL BE EAST JORDAN IRON WORKS TYPE M2, NEENAH TYPE C, OR EQUIVALENT. ALL BAR EDGES TO BE ROUNDED 1/8" RADIUS.
- D. CONCRETE, CAST-IN-PLACE, TO BE ODOT QC MISC. (CEMENT ONLY - NO POZZOLAN MATERIAL). PRECAST CONSTRUCTION PERMITTED AND CONCRETE SHALL MEET THE REQUIREMENTS OF 706.13. KNOCKOUTS MAY BE PROVIDED IN PRECAST CONSTRUCTION. PRECAST WALLS SHALL HAVE A SUFFICIENT AMOUNT OF REINFORCEMENT TO PERMIT SHIPPING AND PLACEMENT WITHOUT DAMAGE.
- E. CARE SHALL BE TAKEN WHEN CONNECTING TO AN EXISTING CATCH BASIN TO KEEP OPENING AS MINIMAL AS POSSIBLE. IF POSSIBLE, SAWCUT OR USE ROTARY HAMMER FOR OPENING TO MINIMIZE DAMAGE TO CATCH BASIN. PIPE TO INTRUDE INTO CATCH BASIN 1" ONLY AND PIPE MUST BE CUT PARALLEL TO CATCH BASIN. USE NONSHRINK GROUT AROUND PIPE TO SEAL BETWEEN PIPE AND CATCH BASIN.
- F. DROP FLOW LINE 1/2" WITHIN BLOCK OUT OF COMBINED CURB AND GUTTER WHILE KEEPING LIP OF GUTTER CONSISTENT WITH TOP OF CURB.
- G. AFTER CASTING IS ADJUSTED TO GRADE, ADJUSTMENT SLOTS IN BACK OF CASTING NEEDS TO BE GROUT SHUT.

**ONE CHOICE ENGINEERING**

SIDNEY, OHIO 937.497.0200  
LOVELAND, OHIO 513.239.8554  
PORTLAND, INDIANA 260.766.2500  
www.CHOICEENGINEERING.com

**FAIRFIELD INN & SUITES SITE PLAN  
CITY OF GROVE CITY, FRANKLIN COUNTY, OHIO**


**GENERAL DETAILS**

REVISIONS:

FILE NAME	GENERAL DETAILS1
DRAWN BY	JMK
CHECKED BY	JSP
PROJECT No.	FRAGC1602
DATE	07-26-2016
SHEET NUMBER	5 OF 17

**FIRE HYDRANT NOTES**

THE FIRE HYDRANT SHALL BE INSTALLED AS SPECIFIED HEREIN AND IN ACCORDANCE WITH THE CITY OF GROVE CITY STANDARD DRAWING No. C-GC-32, THE CITY OF COLUMBUS STANDARD WATER DRAWINGS No. L-6637, TYPE A SETTING, No. L-6409, TYPE B SETTING, OR AS SPECIFIED BY THE CITY ENGINEER. FOR ADDITIONAL NOTES REFER TO THE CITY OF GROVE CITY STANDARD DRAWING No. C-GC-32.

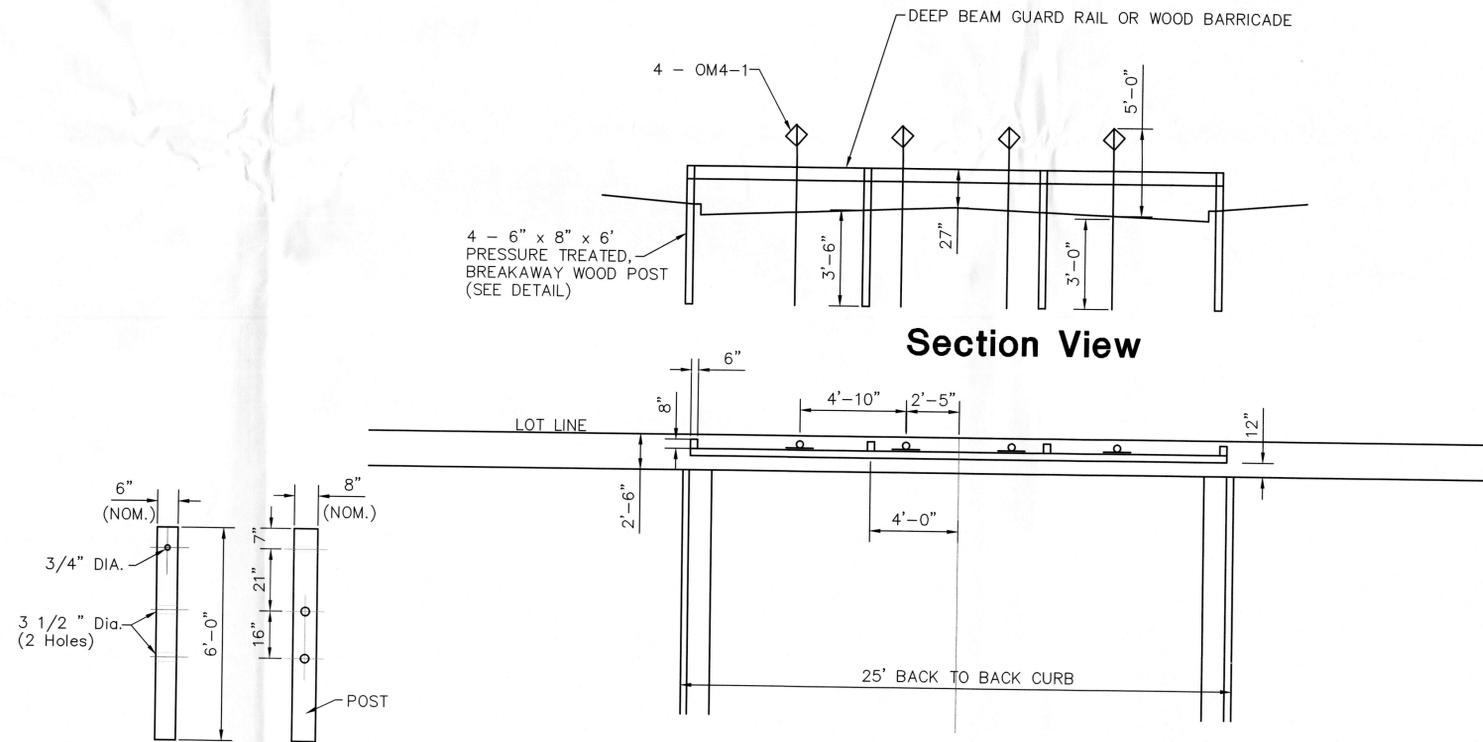

**Type I - Breakaway Post**

WOOD BARRICADE TO BE 2" X 8" TO 12" HEIGHT WITH ORANGE AND WHITE REFLECTORIZED STRIPES. TOP OF BARRICADE TO BE 27" ABOVE TOP OF PAVEMENT.

NOTE:  
TEMPORARY BARRICADE TO BE PLACED AT THE END OF THE ACCESS DRIVE.

**Plan View  
Temporary End of Drive  
Barricade Detail**



No Scale  
**1 REQUIRED**

**CHOICE**  
**ONE**  
**ENGINEERING**

SIDNEY, OHIO 937-497-0200  
LOVELAND, OHIO 513-239-8554  
PORTLAND, INDIANA 260-766-2500  
www.CHOICEENGINEERING.com

**FAIRFIELD INN & SUITES SITE PLAN**  
**CITY OF GROVE CITY, FRANKLIN COUNTY, OHIO**  
**GENERAL DETAILS**

REVISIONS:
FILE NAME GENERAL DETAILS3
DRAWN BY JMK
CHECKED BY JSP
PROJECT No. FRAGC1602
DATE 07-26-2016
SHEET NUMBER

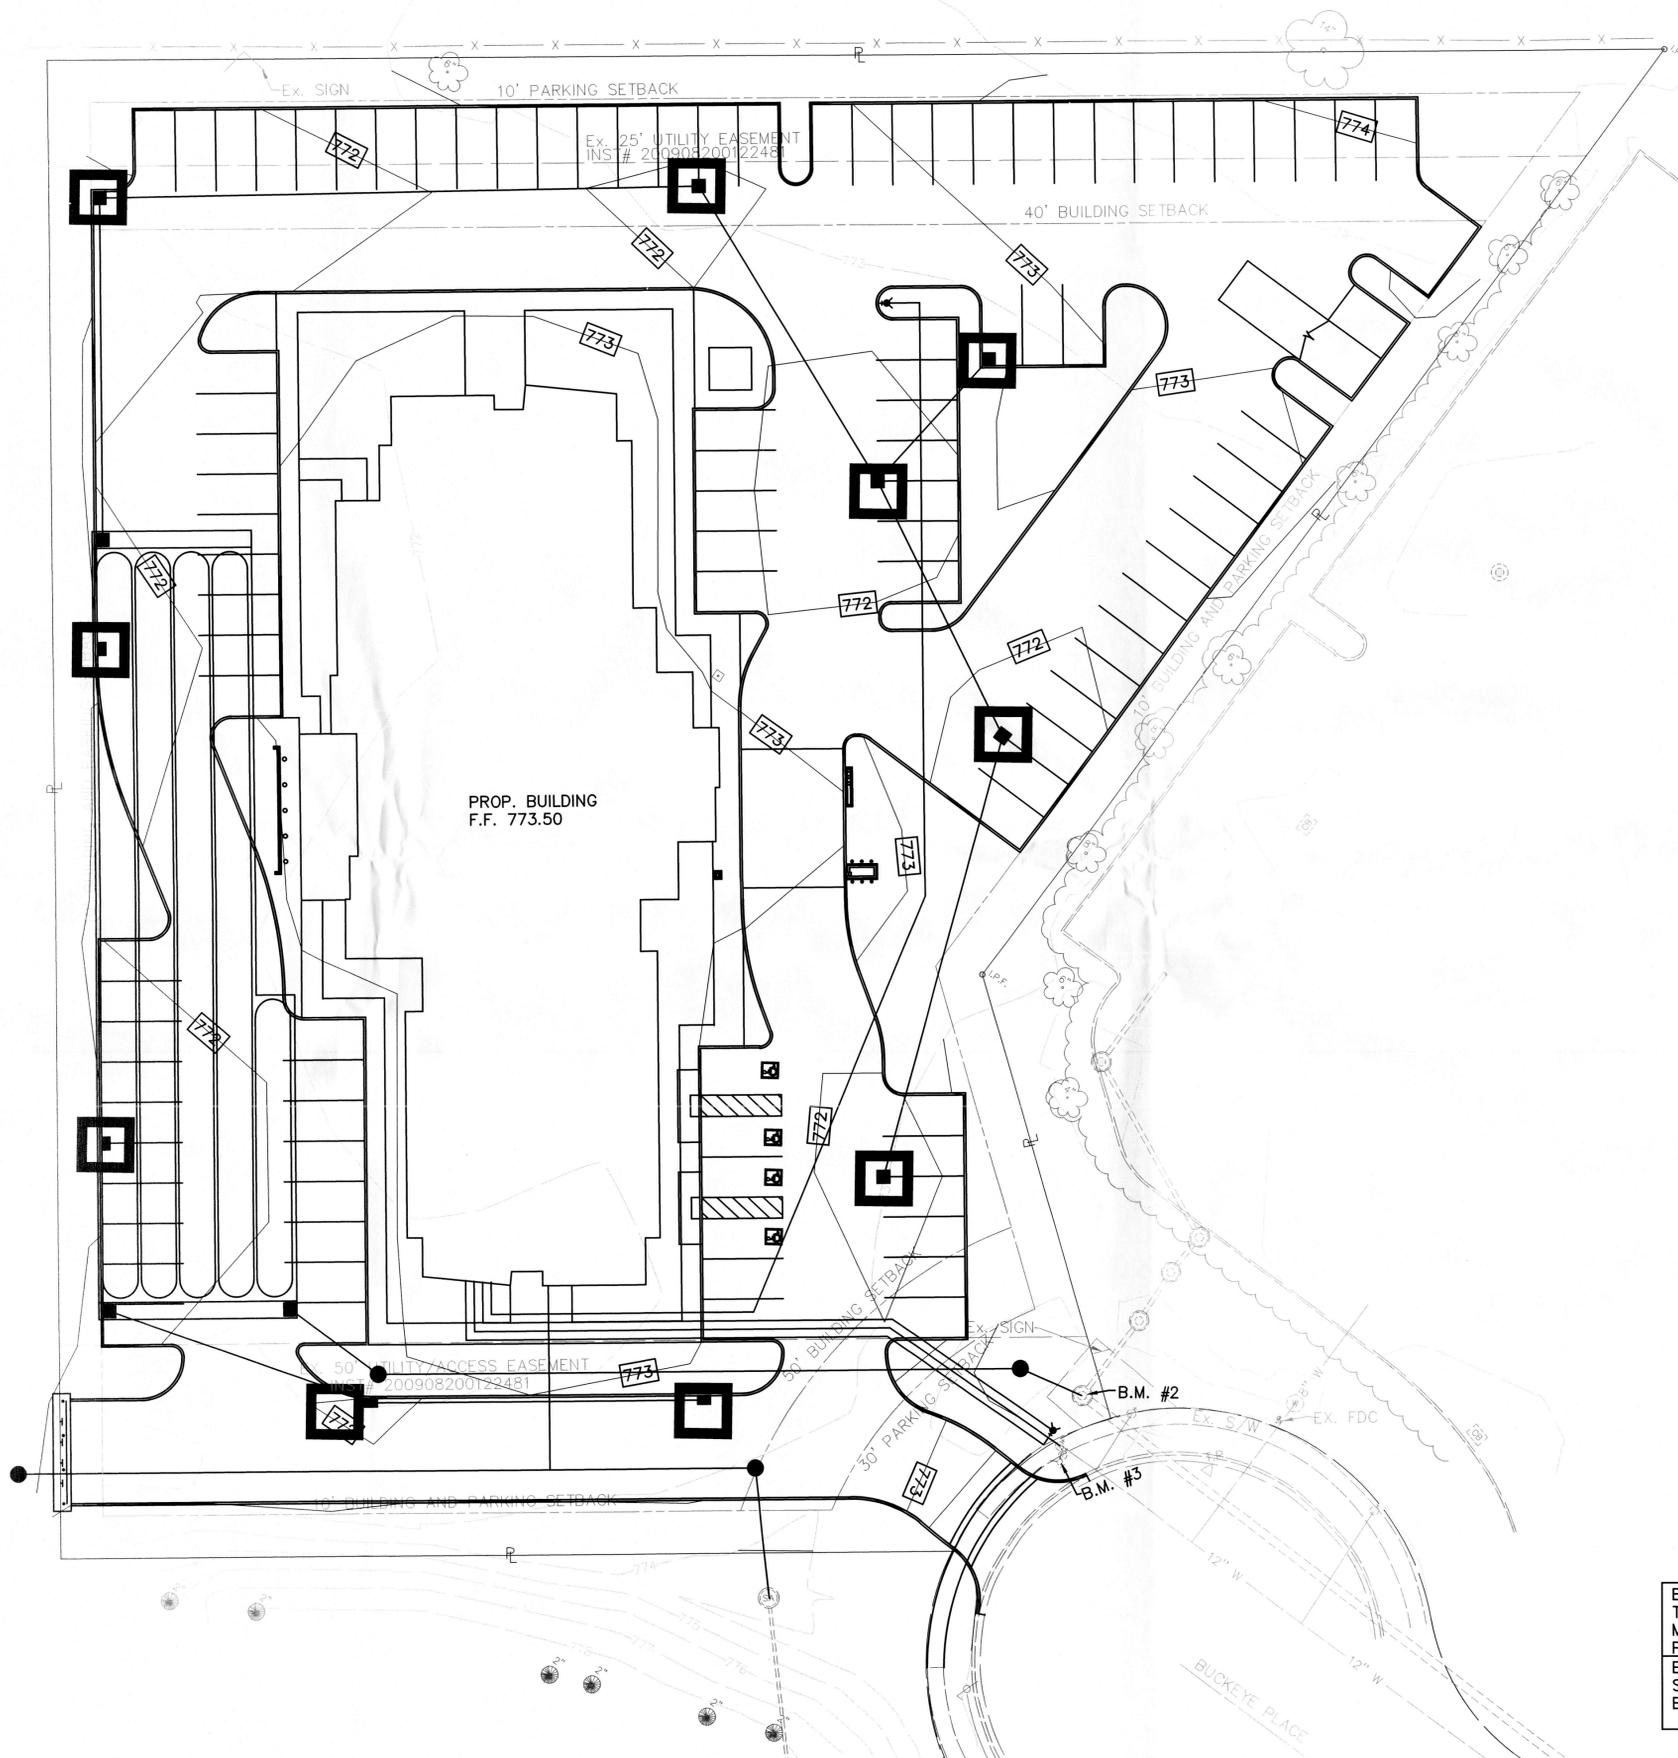

**NOTES:**  
 CONTRACTOR TO VERIFY EXACT LOCATION, DEPTH AND SIZE OF UTILITIES PRIOR TO CONSTRUCTION. CONTRACTOR SHALL NOTIFY OWNER OF ANY CONFLICTS PRIOR TO THE INSTALLATION OF UTILITIES.

ALL UTILITIES ARE TO BE INSTALLED PER CITY OF GROVE CITY STANDARDS.

CONTRACTOR TO TIE INTO EXISTING PAVEMENT ELEVATIONS AS REQUIRED WHERE EVER NEW PAVEMENT ABUTS UP TO EXISTING PAVEMENT TO ENSURE A SMOOTH TRANSITION. ALL EX. PAVEMENT ELEVATIONS GIVEN ARE APPROXIMATED AND SHALL BE FIELD VERIFIED. CONTRACTOR SHALL ALSO ENSURE THAT A SMOOTH TRANSITION IS PROVIDED WHERE EVER PROPOSED GRADES MEET EXISTING GRADES THROUGHOUT THE SITE.

THE GRADE AT THE PROPOSED BUILDING IS TO BE 6" LOWER THAN FINISH FLOOR, UNLESS SHOWN OTHERWISE, AND GRADED TO DRAIN TO THE PROPOSED CATCH BASIN OR YARD DRAIN.

**LEGEND**

- 840 - EXISTING CONTOURS
- [840] - PROPOSED CONTOURS
- [ ] - PROPOSED STORM SEWER
- [ ] - PROPOSED EDGE PAVEMENT
- [ ] - PROPOSED CURB
- F - F - PROPOSED FILTER FABRIC FENCE MEASURE
- [ ] - PROPOSED INLET PROTECTION

BENCHMARK #2 ELEV. 773.14  
 TOP OF CASTING OF SOUTH RIM OF A STORM MANHOLE AT THE WEST END OF BUCKEYE PLACE CUL DE SAC.

BENCHMARK #3 ELEV. 775.15  
 SOUTH BOLT OF FH AT THE CAL DE SAC OF BUCKEYE PLACE

**CHOICE ONE ENGINEERING**


SIDNEY, OHIO 937.497.0000  
 LOVELAND, OHIO 513.239.8354  
 PORTLAND, INDIANA 260.766.2500  
 WWW.CHOICEENGINEERING.COM

**FAIRFIELD INN & SUITES SITE PLAN  
 CITY OF GROVE CITY, FRANKLIN COUNTY, OHIO  
 GRADING AND EROSION CONTROL PLAN**

REVISIONS:
FILE NAME GRADING PLAN
DRAWN BY JMK
CHECKED BY JSP
PROJECT No. FRAGC1602
DATE 07-26-2016
SHEET NUMBER 9 OF 17

REVISIONS:

FILE NAME  
 UTILITY PLAN  
 DRAWN BY  
 JMK  
 CHECKED BY  
 JSP  
 PROJECT No.  
 FRAGC11602  
 DATE  
 07-26-2016  
 SHEET NUMBER



**NOTES:**  
 CONTRACTOR TO VERIFY EXACT LOCATION, DEPTH AND SIZE OF UTILITIES PRIOR TO CONSTRUCTION. CONTRACTOR SHALL NOTIFY OWNER OF ANY CONFLICTS PRIOR TO THE INSTALLATION OF UTILITIES.

ALL UTILITIES TO BE INSTALLED PER CITY OF GROVE CITY STANDARDS. THE WATER IS TO BE INSTALLED PER CITY OF COLUMBUS DIVISION OF WATER.

CONTRACTOR TO VERIFY AND LOCATE WHERE STORM, SANITARY, AND WATER LATERALS AND ALL OTHER PROPOSED UTILITY SERVICES TIE INTO THE PROPOSED BUILDINGS PER BUILDING PLANS. CONTRACTOR SHALL ALSO VERIFY THE SIZES AND TYPES OF ALL LATERALS AND HOW THEY MAY TIE INTO THE PROPOSED BUILDINGS.


CONTRACTOR TO FOLLOW ALL PERMIT REQUIREMENTS AND SPECIFICATIONS TO INSTALL THE PROPOSED UTILITIES INCLUDING COORDINATING THE INSTALLATION WITH LOCAL OFFICIALS AS NEEDED AND/OR REQUIRED.

**WATER MAIN CROSSING SEPARATION NOTE:**  
 WHENEVER A SANITARY OR STORM SEWER AND WATER LINE MUST CROSS, THE SEWER AND WATER SHALL BE LAID AT SUCH AN ELEVATION THAT THERE IS AT LEAST 18" OF SEPARATION BETWEEN THE OUTSIDE WALLS OF THE TWO PIPES. IF REQUIRED, CONTRACTOR SHALL LOWER/DIP THE WATER MAIN AS NEEDED TO OBTAIN THE 18" MINIMUM SEPARATION DISTANCE. IF IT IS ABSOLUTELY IMPOSSIBLE TO MAINTAIN THE 18" VERTICAL SEPARATION, THE SANITARY SEWER SHALL BE CONSTRUCTED OF WATER LINE TYPE MATERIALS WHICH WOULD BE ABLE TO WITHSTAND A 100 PSI PRESSURE TEST (NOTE: DO NOT PRESSURE TEST SANITARY SEWER TO 100 PSI). THESE REQUIREMENTS WILL EXTEND FOR THE DISTANCE OF THE ENTIRE SPAN. NO CHANGE OF MATERIALS ARE ALLOWED MID-SPAN.


AT CROSSINGS, THE WATER MAIN SHALL HAVE A MINIMUM VERTICAL DISTANCE OF 18" FROM STORM AND SANITARY SEWERS. ALSO ONE FULL LENGTH OF WATER MAIN SHALL BE LOCATED SO THE JOINTS ARE AS FAR FROM THE STORM AND SANITARY SEWERS AS POSSIBLE.

**GAS, COMMUNICATION, ELECTRIC NOTE:**  
 CONTRACTOR TO LOWER/DIP THESE UTILITIES AS NEEDED TO AVOID CONFLICTS WITH ANY SANITARY, STORM OR WATER LINES OR ANY OTHER UTILITIES THEY MAY CONFLICT WITH.


CONTRACTOR IS RESPONSIBLE FOR ALL DOWNSPOUT PIPING. ALL DOWNSPOUT PIPING FROM BUILDING TO THE COLLECTOR LINE SHALL BE A MINIMUM DIAMETER OF 6" AND SHALL BE CONNECTED TO THE COLLECTOR LINES USING A TEE/WYE. AN INSERTA TEE IS TO BE USED FOR DOWNSPOUTS THAT ARE CONNECTED DIRECTLY TO THE STORM MAIN. CONTRACTOR TO VERIFY ALL DOWNSPOUT LOCATIONS WITH ARCHITECT.

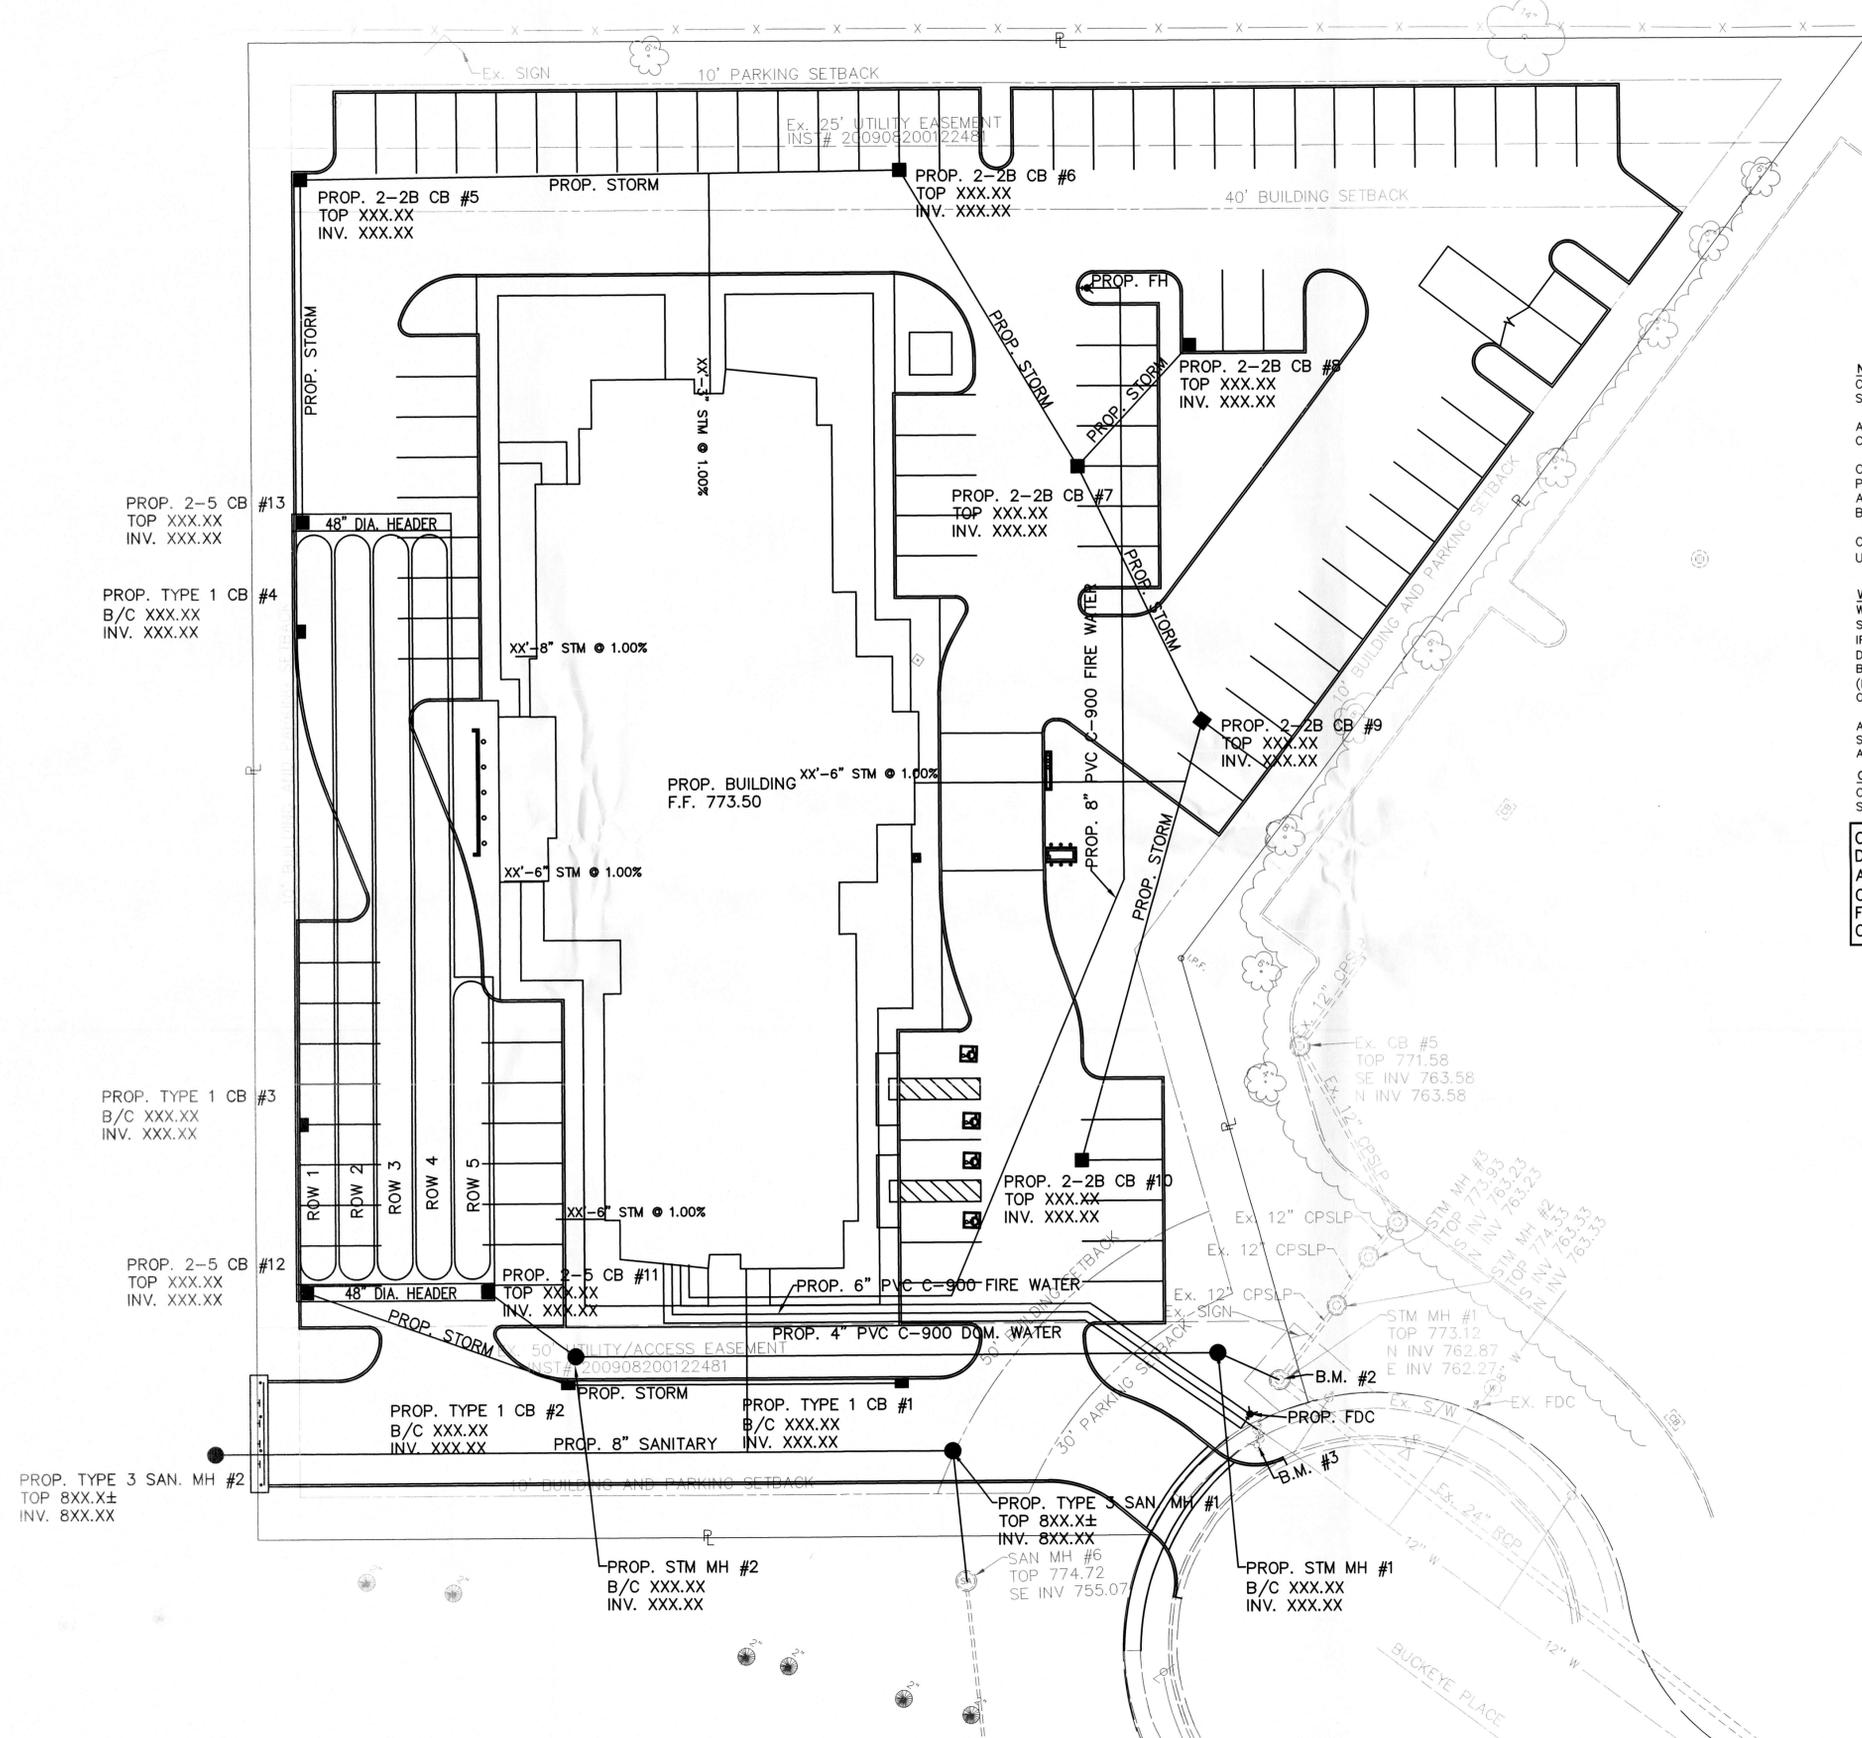



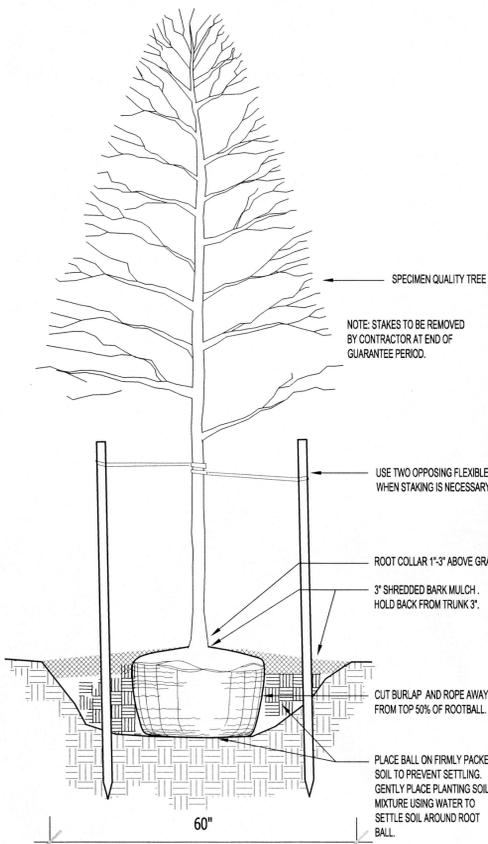

1 TREE PLANTING DETAIL  
3/4"=1'-0"

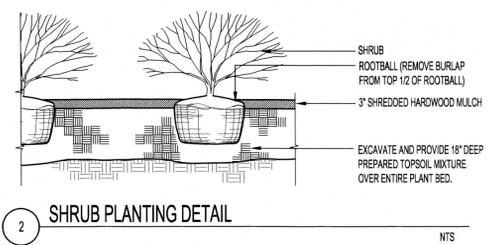


2 SHRUB PLANTING DETAIL  
NTS

PLANTING MATERIALS LIST

QTY.	COMMON NAME	BOTANICAL NAME	SIZE	ROOT
<b>TREES</b>				
6	LITTLE LEAF LINDEN	TILIA CORDATA	2" cal.	B&B
2	IVORY SILK TREE LILAC	SYRINGA RETICULATA	2" cal.	B&B
4	WINTER KING HAWTHORN	CRATAEGUS VIRIDIS 'WINTER KING'	2" cal.	B&B
9	SKYLINE HONEYLOCUST	GLEDITIA T. I. 'SKYLINE'	2" cal.	B&B
4	EASTERN REDBUD	CERCIS CANADENSIS	2" cal.	B&B
3	AMERICAN YELLOWWOOD	CLADASTRIS KENTUCKIA	2" cal.	B&B
5	GREEN MOUNTAIN SUGAR MAPLE	ACER SACCHARUM 'GREEN MOUNTAIN'	2" cal.	B&B
8	RED OAK	QUERCUS RUBRA	2" cal.	B&B
10	ANN MAGNOLIA	MAGNOLIA 'ANN'	2" cal.	B&B
3	PRINCETON ELM	ULMUS AMERICANA	2" cal.	B&B
10	EASTERN WHITE PINE	PINUS STROBUS	6' HGT.	B&B
2	SERBIAN SPRUCE	PICEA OMORICA	6' HGT.	B&B
4	CELEBRATION MAPLE	ACER X. FREEMANII 'CELZAM'	2" cal.	B&B
3	FRANS FONTAINE HORNBREAM	CARPINUS B. 'FRANS FONTAINE'	2" cal.	B&B
<b>SHRUBS</b>				
32	DWARF FOTHERGILLA	FOTHERGILLA GARDENII	24" Spr.	B&B
65	DENSE YEW	TAXUS DENSIFORMIS	36" Spr.	B&B
42	ANNABELLE HYDRANGEA	HYDRANGEA 'ANNABELLE'	24" Spr.	B&B
13	KOREAN SPICE VIBURNUM	VIBURNUM CARLESII	36" Spr.	B&B
42	KALLAY'S COMPACT JUNIPER	JUNIPERUS CH. 'KALLAY'S COMPACT'	36" Spr.	B&B
15	BOOMERANG PINK PERFUME LILAC	SYRINGA X 'PINK PERFUME' PPAF	24" Spr.	B&B
5	FINELINE BUCKTHORN	RHAMNUS F. 'FINE LINE'	3' HGT.	#5 Cont.
6	LIMELIGHT HYDRANGEA	HYDRANGEA PANICULATA 'LIMELIGHT'	36" Spr.	B&B
30	ROSE GLOW BARBERRY	BERBERIS T. 'ROSE GLOW'	24" Spr.	#3 Cont.
12	CALGARY CARPET JUNIPER	JUNIPERUS S. 'CALGARY CARPET'	18" Spr.	No. 3 Cont.
64	GREEN VELVET BOXWOOD	BUXUS 'GREEN VELVET'	24" Spr.	B&B
12	BIRD'S NEST SPRUCE	PICEA A. 'NIDIFORMIS'	18" Spr.	No. 5 Cont.
1	WINTERGREEN ARBORVITAE	THUJA O. 'WINTERGREEN'	8' HGT.	B&B
8	EMERALD ARBORVITAE	THUJA 'EMERALD'	6' HGT.	B&B
3	WOODWARD GLOBE ARBORVITAE	THUJA O. 'WOODWARDII'	18" Spr.	B&B
4	DEGROOT'S SPIRE ARBORVITAE	THUJA 'DEGROOT'S SPIRE'	4' HGT.	B&B
5	SKY ROCKET JUNIPER	JUNIPERUS 'SKY ROCKET'	4' HGT.	B&B
<b>GRASSES</b>				
6	DWARF FOUNTAIN GRASS	PENISETUM HAMELII	clump	No. 2 Cont.
14	KARL FOERSTER REED GRASS	CALAMAGROSTIS X AC 'KARL FOERSTER'	clump	No. 2 Cont.
9	SILVER MAIDEN GRASS	MISCANTHUS S. 'GRAZIELLA'	clump	#2 Cont.


PERENNIALS

12	STELLA DE ORO DAYLILY	HEMEROCALLIS 'STELLA DE ORO'	CLUMP	No. 2 Cont.
20	BLACK EYED SUSAN	REDBECKIA FVS 'GOLDSTURM'	CLUMP	No. 2 Cont.
24	AUTUMN JOY SEDUM	SEDUM 'AUTUMN JOY'	CLUMP	No. 2 Cont.
32	BIG BLUE LILYTURF	LIRIOPE 'BIG BLUE'	CLUMP	No. 2 Cont.
46	BLUE ANGEL HOSTA	HOSTA 'BLUE ANGEL'	CLUMP	No. 2 Cont.
12	ROZANNE GERANIUM	GERANIUM 'ROZANNE'	CLUMP	No. 2 Cont.

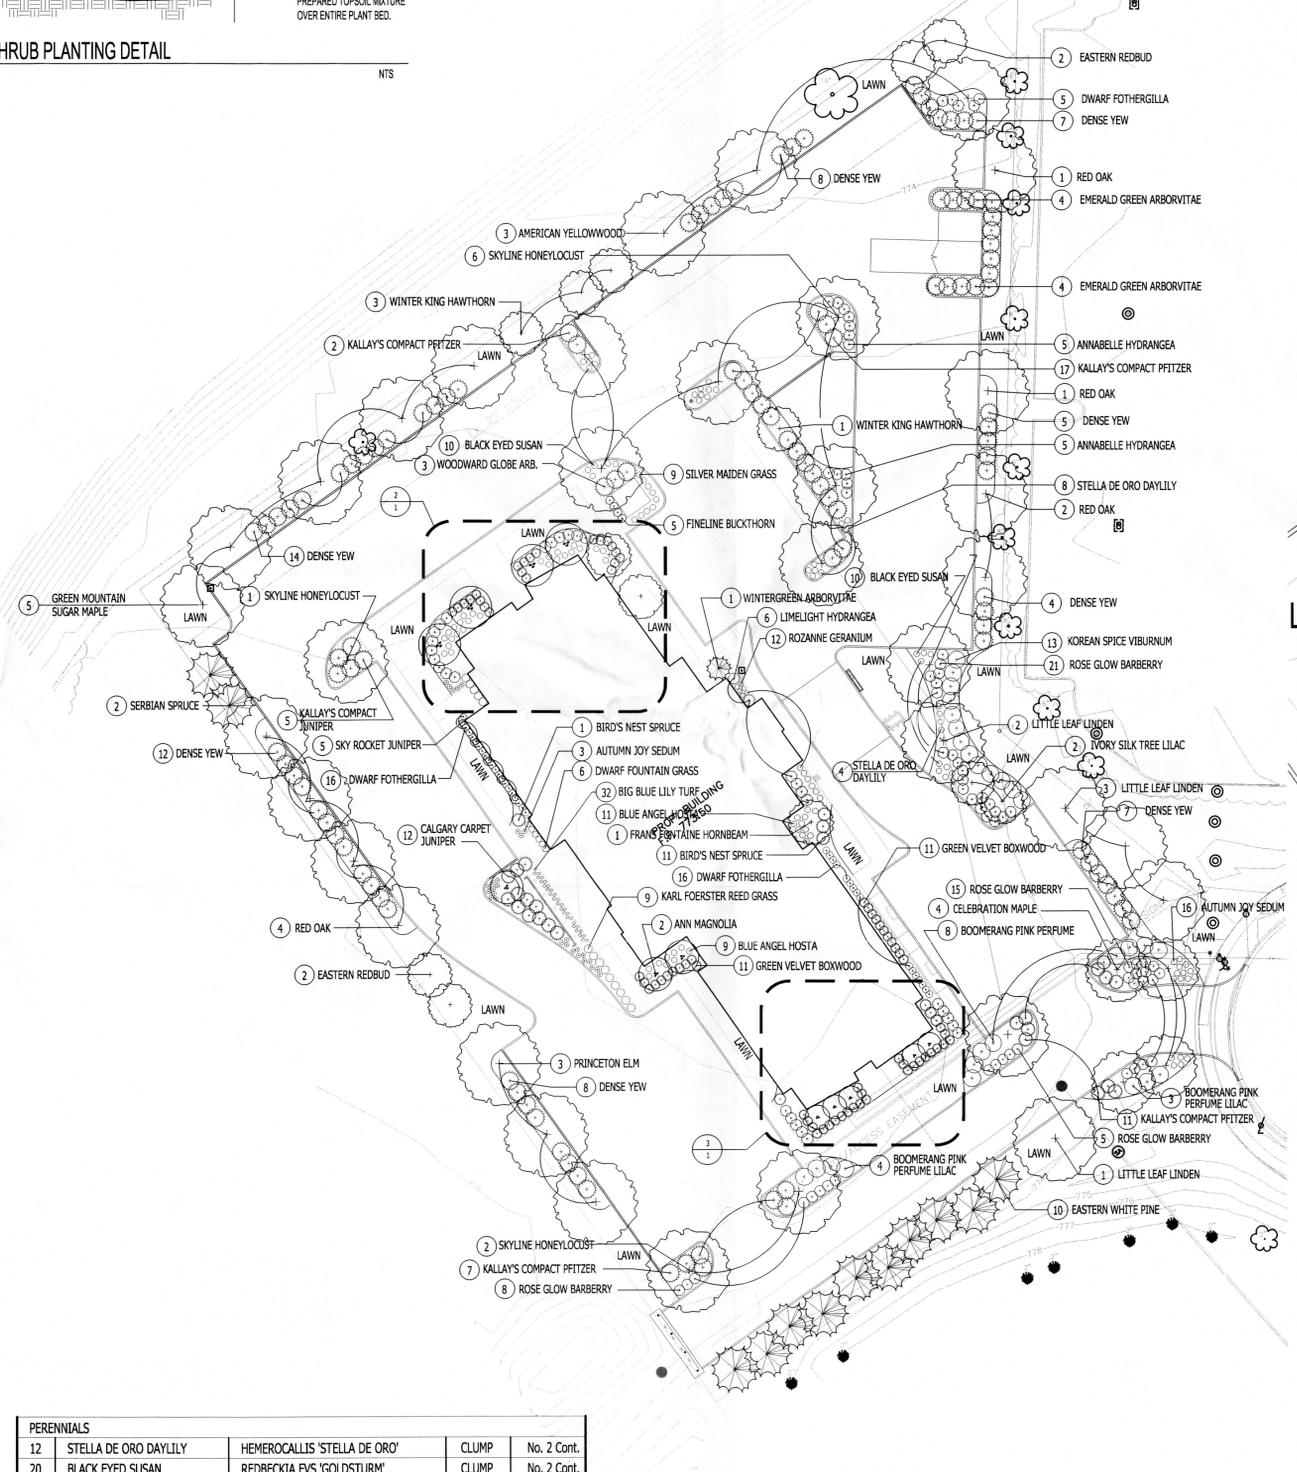

1 OVERALL LANDSCAPE PLAN  
1"=10'-0"

SEED ALL AREAS  
DISTURBED BY CONSTRUCTION

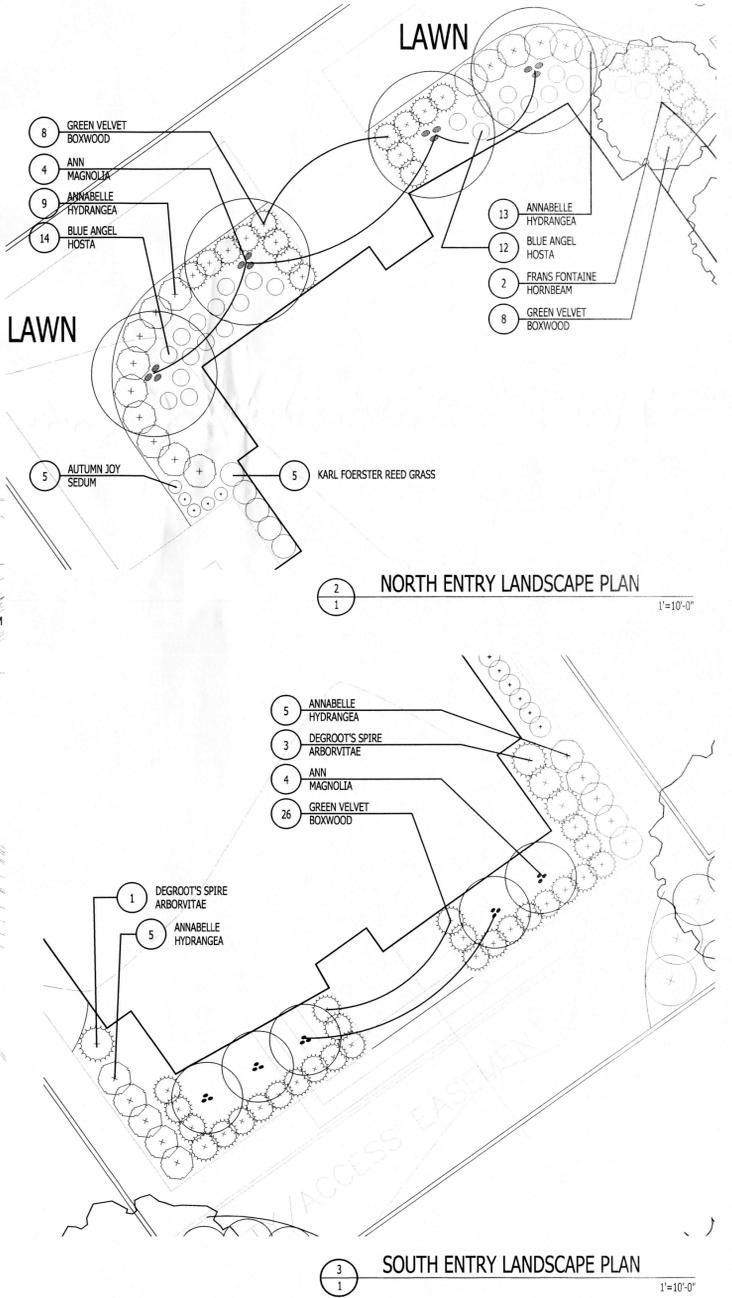

2 NORTH ENTRY LANDSCAPE PLAN  
1"=10'-0"

3 SOUTH ENTRY LANDSCAPE PLAN  
1"=10'-0"

GENERAL NOTES

- A. PLANTS INSTALL 3" LAYER OF SHREDDED WOOD BARK MULCH TO ALL PLANT BEDS.
- B. ALL PLANTS OCCURRING IN A CONTINUOUS ROW OR FORMAL ARRANGEMENT SHALL HAVE UNIFORM HEIGHT AND SPREAD AND HABIT OF GROWTH.
- C. ALL SHRUB BEDS SHALL BE EXCAVATED AND BACKFILLED AS SHOWN.
- D. ALL SERVICE STRUCTURES SHOULD BE SCREENED PER SECTION 1136.08
- E. 50% OF BURLAP AND WIRE MUST BE REMOVED AT THE TIME OF PLANTING.


ONE CHOICE ENGINEERING  
 SIDNEY, OHIO 937.497.0000  
 LOVELAND, OHIO 513.238.8554  
 PORTLAND, INDIANA 766.766.2500  
 WWW.CHOICEENGINEERING.COM

FAIRFIELD INN & SUITES SITE PLAN  
 CITY OF GROVE CITY, FRANKLIN COUNTY, OHIO  
 LANDSCAPE PLAN

REVISIONS:  
 FILE NAME: FRAG1602.dwg  
 DRAWN BY: JMK  
 CHECKED BY: JSP  
 PROJECT No: FRAG1602  
 DATE: 07-25-16  
 SHEET NUMBER: 1 OF 1

Symbol	Label	Quantity	Manufacturer	Catalog Number	Description	Lamp	Number Lamps	Filename	Lumens Per Lamp	Light Loss Factor	Wattage
□	SA	10	BEACON PRODUCTS	60NB-136-T3-5K		60 NICHIA LEDS	1	60NB-136-T3 (26 DNL)ies	12845	1	139.9
□	SB	1	BEACON PRODUCTS	60NB-136-T2	60NB-136-T2 AREA LIGHT	60 NICHIA 5K LEDS	1	60NB-136-T2ies	12131	1	136
□	SC	2	BEACON PRODUCTS	36NB-80-T2	36NB-80-T2 AREA LIGHT	36 NICHIA 5K LEDS	1	36NB-80-T2ies	7278	1	80

No.	Label	MH
1	SA	30.00
2	SC	30.00
3	SA	30.00
4	SA	30.00
5	SA	30.00
6	SA	30.00
7	SA	30.00
8	SA	30.00
9	SA	30.00
10	SB	30.00
11	SA	30.00
12	SA	30.00
13	SC	30.00

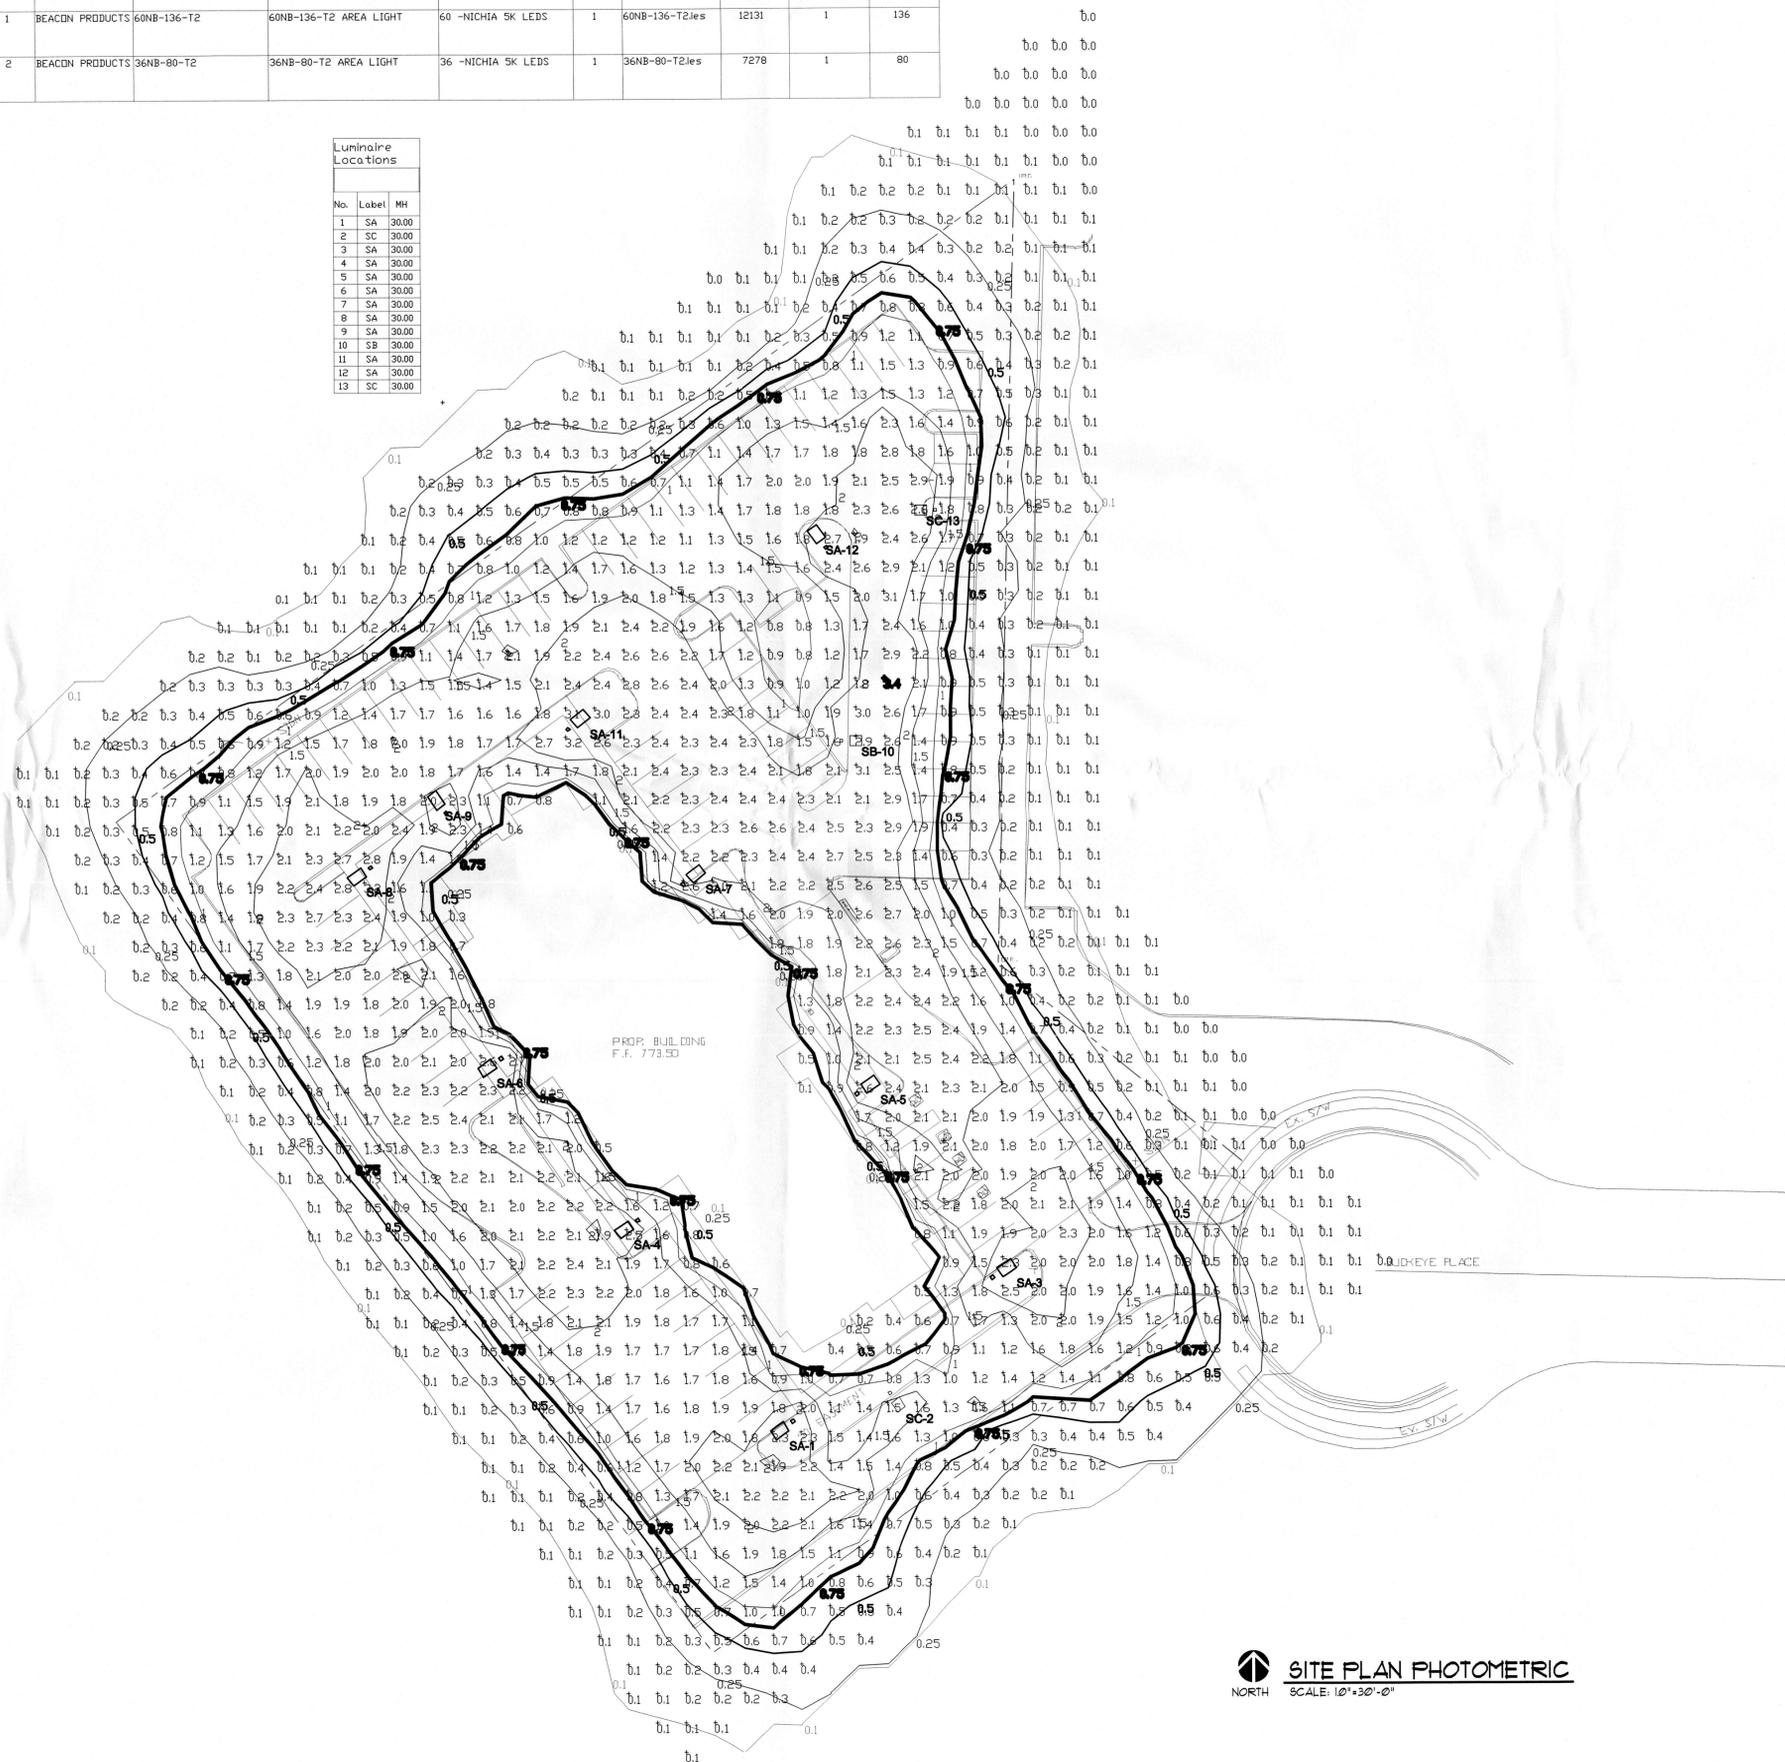

**SITE PLAN PHOTOMETRIC**  
 NORTH SCALE: 1/8"=1'-0"

**ARCHITECTURAL GROUP III**  
 201 S. Nappanee St. Elkhart, Indiana 46514-1963 • 574/293-0008  
 architecturalgroup3.com  
 The Architect is deemed the author, creator, and owner of the design and content of this drawing. All rights are reserved. No part of this drawing may be reproduced, stored in a retrieval system, or transmitted in any form or by any means, electronic, mechanical, photocopying, recording, or by any information storage and retrieval system, without the prior written permission of the Architect.

JOB TITLE

**FAIRFIELD INN & SUITES**  
 GROVE CITY, OH  
 A NEW ROOM HOTEL

JOB NO.  
 16118

DATE  
 06/21/16

REVISIONS

**PRELIMINARY NOT FOR CONSTRUCTION**

SHEET NO.  
**E1.0a**  
 SITE PLAN PHOTOMETRIC