


**SECTION B-B**

All joints to be staggered

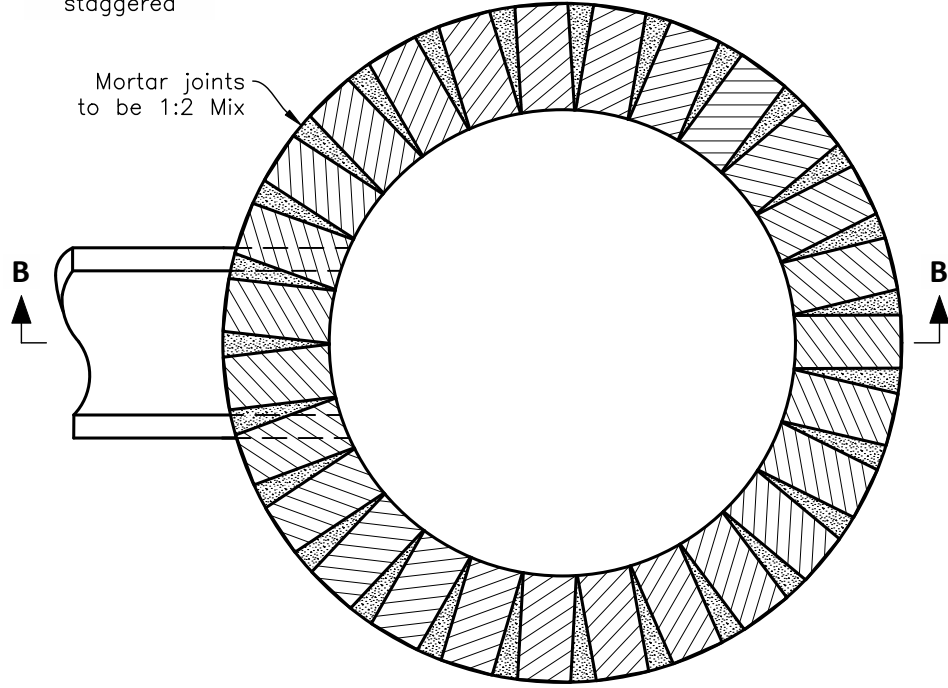

**SECTION A-A**

**DETAIL NOTES**

1. Radius Gutter Inlet shall be placed at sump locations only and set so that the grate flowline is 2-in below the normal gutter elev. Slope gutter to Inlet within 4-ft of grate.
2. Pipes draining into inlet shall be placed 2-in above elevation of outlet pipe.
3. Maximum size of pipe to be used with inlet will be 24-in.
4. Inlets shall be built of brick (per ASTM C216, Grade S.W.), cast in place concrete, or pre-cast concrete.
5. Pre-cast walls shall have a min. thickness of 5-in and be sufficiently reinforced to permit shipping and handling without damage.
6. Precast inlets shall be in accordance with ASTM C913.

Approved By:  
  
 City Engineer, EMH&T Inc  
  
 City Service Director

STANDARD DIMENSIONS  
 FOR  
**RADIUS  
 GUTTER INLET**

<b>CITY OF GROVE CITY, OHIO</b>		
STANDARD CONSTRUCTION DRAWING		
Revised		Drawing No.
February 2019		C-GC-5