


CUT-IN WYE SERVICE CONNECTION

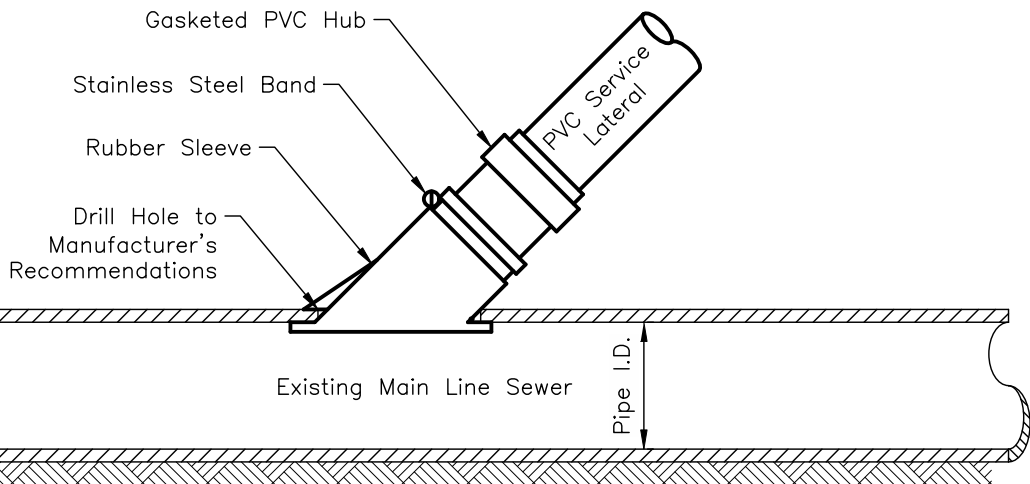

THREE PIECE SERVICE CONNECTION

(Inserta Wye™ or Approved Equal)

DETAIL NOTES

1. New 6-in sanitary laterals on existing sewer pipes shall be installed according to one of the options shown above.
2. Core hole for the 3-piece service connection option shall be made according to the manufacturer's requirements. No pipe chipping or breaking is permitted.
3. The connections shall be water-tight and made using rubber sleeves and stainless steel bands.
4. For the cut-in wye option, a minimum 4-in granular bedding consisting of No. 8 or No. 57 aggregate shall be installed around the new service wye.
5. The flowline and grade of the existing main line sewer shall be maintained and unobstructed at all times.
6. If the house connection is not made immediately after installation of the wye a stopper must be installed.

Approved By:

 City Engineer, EMH&T Inc

 City Service Director

STANDARD DIMENSIONS
 FOR
 SERVICE CONNECTION
 FOR EXISTING SANITARY
 SEWER PIPE

**CITY OF
 GROVE CITY, OHIO**

STANDARD
 CONSTRUCTION DRAWING

Revised
 October 2015

Drawing No.
 C-GC-30