


DETAIL NOTES

1. Concrete for driveway shall be CMSC Class COC 5, Air Entrained Concrete w/Limestone Aggregate and 715 lbs. of cement per C.Y., maximum 4-in slump, broom finish with edge trowel. No Fly Ash or GGBFS in concrete. Contraction joints shown, sawn not less than 2-in deep.
2. Contractor is responsible for protecting adjacent driveway, sidewalk, underdrain, and street lighting cable and replacement of same if damaged due to Contractor's work.
3. Sidewalks shall be constructed according to C-GC-46A.
4. All joints and edges are to be tooled.
5. Any existing castings or valve boxes in driveway approach shall be adjusted to grade.
6. Contractor shall apply a Cure & Seal compound, as approved by the City, to finished concrete.

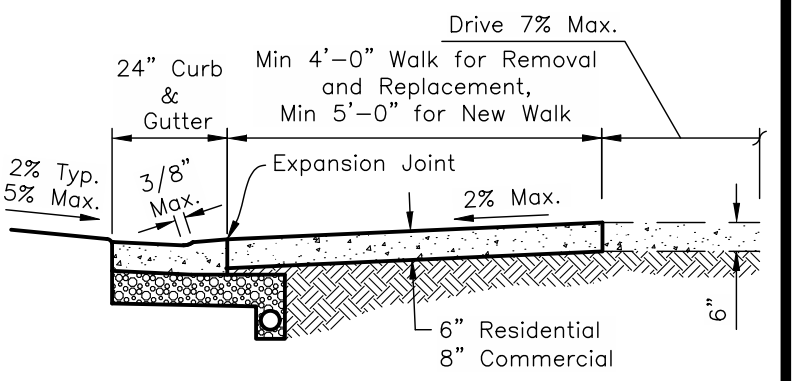

Approved By:

 City Engineer, EMH&T Inc

 City Service Director

STANDARD DIMENSIONS FOR
STANDARD DRIVE WITH SIDEWALK ADJACENT TO CURB ON PUBLIC R/W

CITY OF GROVE CITY, OHIO
 STANDARD CONSTRUCTION DRAWING
 Revised February 2019
 Drawing No. C-GC-46B