


T = 6-in - Residential Streets
 T = 8-in - Collector & Arterial Streets

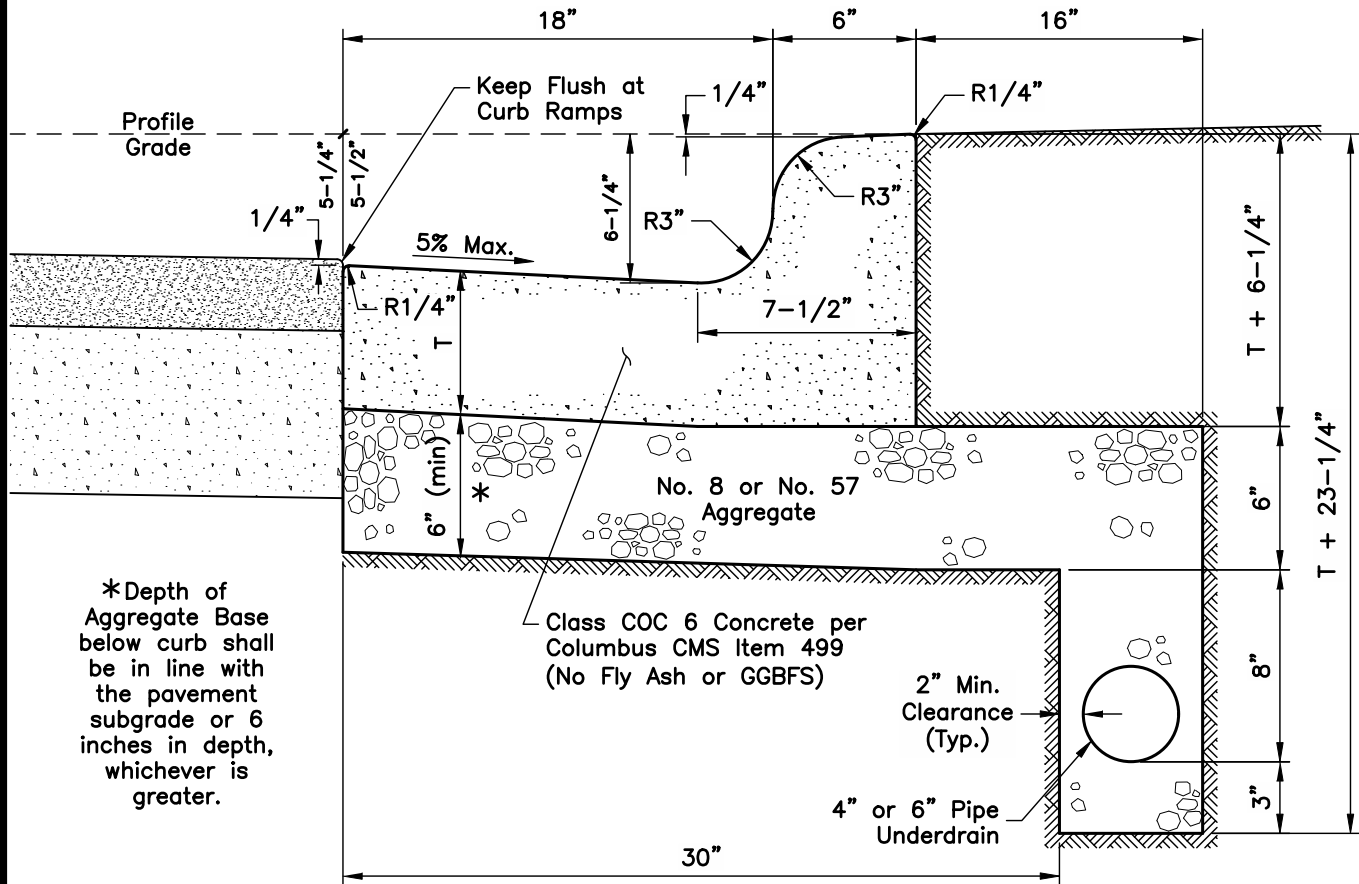

*Depth of Aggregate Base below curb shall be in line with the pavement subgrade or 6 inches in depth, whichever is greater.

DETAIL NOTES

1. Curb & gutter shall consist of 1.26 C.F. (6-in) of concrete per linear foot for residential or local streets and 1.59 C.F. (8-in) of concrete for collector or arterial streets.
2. All exposed surfaces of concrete curb & gutter shall have a brush finish and be completely covered with concrete cure and seal, including the backside of curb.
3. 3/4-in expansion joints shall be installed at right angles to the curb line within 5-ft and 10-ft of all immovable structures and at points of curvature. For replacement work, at an existing joint or no closer than 5-ft from an existing joint.
4. Contraction joints shall be saw cut at 10-ft intervals, not less than 2-in deep, and as soon as possible without causing damage to the concrete.
5. Tolerances shall not exceed 1/4-in for section, grade, surface variation, or alignment.
6. The letter "W" shall be imprinted into the curb directly opposite all water service boxes and the letter "M" shall be imprinted opposite all water line valves, including hydrant watch valves. Letters shall be 3-in high/wide with 1/4-in thick bars, imprinted 1/2-in into the face of the curb, 2-1/2-in above the gutter.

Approved By:

[Signature]

City Engineer, EMH&T Inc

[Signature]

City Service Director

STANDARD DIMENSIONS
 FOR

**ITEM 609: STANDARD
 CONCRETE COMBINED
 CURB & GUTTER
 (CONTINUOUS)**

**CITY OF
 GROVE CITY, OHIO**

STANDARD
 CONSTRUCTION DRAWING

| | | |
|---------------|--|-------------|
| Revised | | Drawing No. |
| February 2019 | | C-GC-57A |