


PLAN VIEW

* = Minimum limits of combined curb & gutter or integral curb to be removed if curb has not yet been previously dropped. All joints to be sawed and provision made for proper contraction joints.

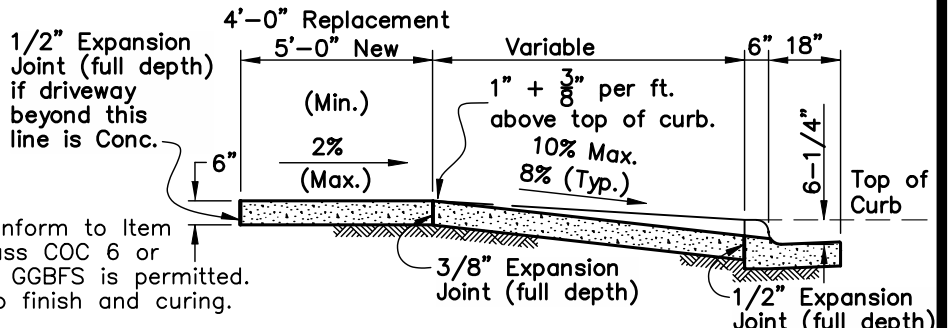

SECTION A-A

DETAIL NOTES

- All materials and construction to conform to Item 452 Columbus CMS. Use either Class COC 6 or COC MS Concrete. No Fly Ash or GGBFS is permitted. Particular attention shall be given to finish and curing.
- Subgrade excavated below the prescribed grade shall be filled with an approved crushed aggregate and compacted as directed.
- When directed by the City, 2-in Duct for street light cable shall be laid under driveway approaches prior to pouring approaches. Duct shall be placed 4-ft back of curb and 24-in below proposed finished grade.
- Surfaces shall be broom finish and all joints and edges shall be tooled after broom finish. Any existing castings or valve boxes in driveway approach shall be adjusted to grade.
- Drive apron, sidewalk across approach, integral or straight curb, and curb & gutter adjacent to street shall be included in the price bid for this item.
- Contractor shall apply a cure & seal compound, as approved by the City, to finished concrete.
- Contraction Joints shall not be less than 2-in in depth.
- Residential Drive spacing shall be a minimum of 50'-0" from centerline to centerline.

Approved By:

[Signature]

City Engineer, EMH&T Inc

[Signature]

City Service Director

STANDARD DIMENSIONS
FOR
**RESIDENTIAL DRIVEWAY
APPROACH**

CITY OF GROVE CITY, OHIO	
STANDARD CONSTRUCTION DRAWING	
Revised	Drawing No.
February 2019	C-GC-41A