


PLAN VIEW

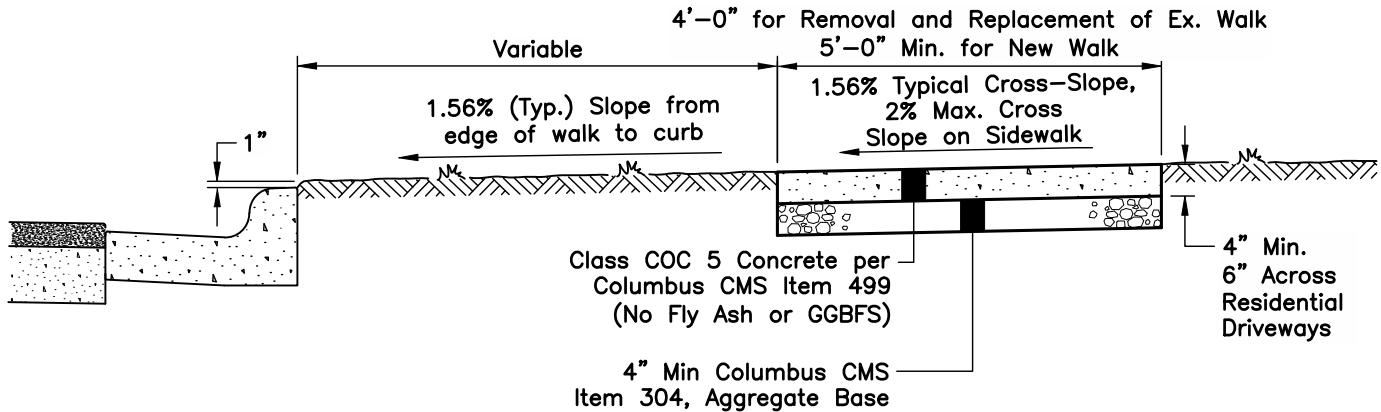

SECTION A-A

DETAIL NOTES

1. Existing sidewalk to be replaced may be replaced at the same width as existing.
2. Sidewalks shall be constructed according to Columbus CMS Item 608.
3. All joints and edges shall be tooled after broom finish.
4. Sidewalk surface shall have a broom finish.
5. All castings shall be set to proper grade. Where feasible, tool a joint at the casting location to control cracking.
6. All concrete shall contain 6% ±2% air entrainment.
7. Contraction Joints shall be not less than 2-in in depth.
8. Contractor shall apply a cure & seal compound, as approved by the City, to finished concrete.
9. For removal and replacement of existing sidewalk, the width shall match that of the existing walk, or be a minimum of 4-ft in width, whichever is greater. For new walk, the width shall be 5-ft.

Approved By:

 City Engineer, EMH&T Inc

 City Service Director

STANDARD DIMENSIONS
 FOR
TYPICAL SIDEWALK DETAIL

CITY OF GROVE CITY, OHIO		
STANDARD CONSTRUCTION DRAWING		
Revised		Drawing No.
February 2019		C-GC-46A